

FIRE DEPT. 3 Vol. Co. 41 Men paid force, run. 3 Hose Has. 1 Sigsby Steamer drawn by either hand or horses. 3 Hand Truck Carts 2500 2 1/2" Hose. 4 Ladders. No Truck. 1 Hand Eng. not used. Fire Alarm Bell, Telephone & Whistle.

WATER FACILITIES: Water works owned by City Direct & Gravity System. 2 Worthington Steam pumps size 14" x 8 1/2" x 10" Cap. 15 Million Gals. ea. per 24 hrs. 1 Turbine Pump Cap. 1000 Gals. per min. operated by 63 HP Elec. mot. All pumps draw from well & pump direct to water mains & to water tank cap 100,000 Gals. on steel trestle 45' high. Domestic Pressure 70 lbs. Fire Pressure 120 lbs. 11 Miles of 4" & 6" Water Mains 72 D.Hs. Daily Consumption About 200,000 Gals.

Streets Unpaved. For grades see detail sheets. Public Lights: Elec.

INDEX


STREETS	SHEET	SPECIALS	SHEET
Alice	6	Argo Milling Co.	3
Antrim	100-144 *5		
"	101-145 *4		
"	200-809 2		
B			
Barth, H. N., Mrs., Boiler Works	6		
Bartlett House	4		
Beach Hotel	3		
Belvidere Hotel	3		
Blair, B. B., Florist	3		
C			
Charlevoix Elec. Light & Water Works	1		
"	3		
"	4		
"	5		
"	6		
"	7		
"	8		
"	9		
"	10		
"	11		
"	12		
"	13		
"	14		
"	15		
"	16		
"	17		
"	18		
"	19		
"	20		
"	21		
"	22		
"	23		
"	24		
"	25		
"	26		
"	27		
"	28		
"	29		
"	30		
"	31		
"	32		
"	33		
"	34		
"	35		
"	36		
"	37		
"	38		
"	39		
"	40		
"	41		
"	42		
"	43		
"	44		
"	45		
"	46		
"	47		
"	48		
"	49		
"	50		
"	51		
"	52		
"	53		
"	54		
"	55		
"	56		
"	57		
"	58		
"	59		
"	60		
"	61		
"	62		
"	63		
"	64		
"	65		
"	66		
"	67		
"	68		
"	69		
"	70		
"	71		
"	72		
"	73		
"	74		
"	75		
"	76		
"	77		
"	78		
"	79		
"	80		
"	81		
"	82		
"	83		
"	84		
"	85		
"	86		
"	87		
"	88		
"	89		
"	90		
"	91		
"	92		
"	93		
"	94		
"	95		
"	96		
"	97		
"	98		
"	99		
"	100		

KEY

FIRE WALL ON ABY ROOF
METAL CORNICE
FIRE WALL IN ABY ROOF
WOOD CORNICE
FIRE WALL IN ABY ROOF
FRAME PARTITION
OPENING WITH IRON DOOR
STANDARD
IRON DOOR
WINDOWS AND IRON SHUTTERS
RED BRICK
BLUE IRON
GRAY ADOBE
GREEN SPECIALS

STABLE
BUILDINGS COLORED YELLOW ARE FRAME
RED BRICK
BLUE IRON
GRAY ADOBE
GREEN SPECIALS


INDICATE RELATIVE HEIGHTS
FIRE STATION, AS SHOWN ON KEY MAP
ALTERNATE STREET NUMBERS ARE ACTUAL
CONSECUTIVE STREET NOS ARE ARBITRARY

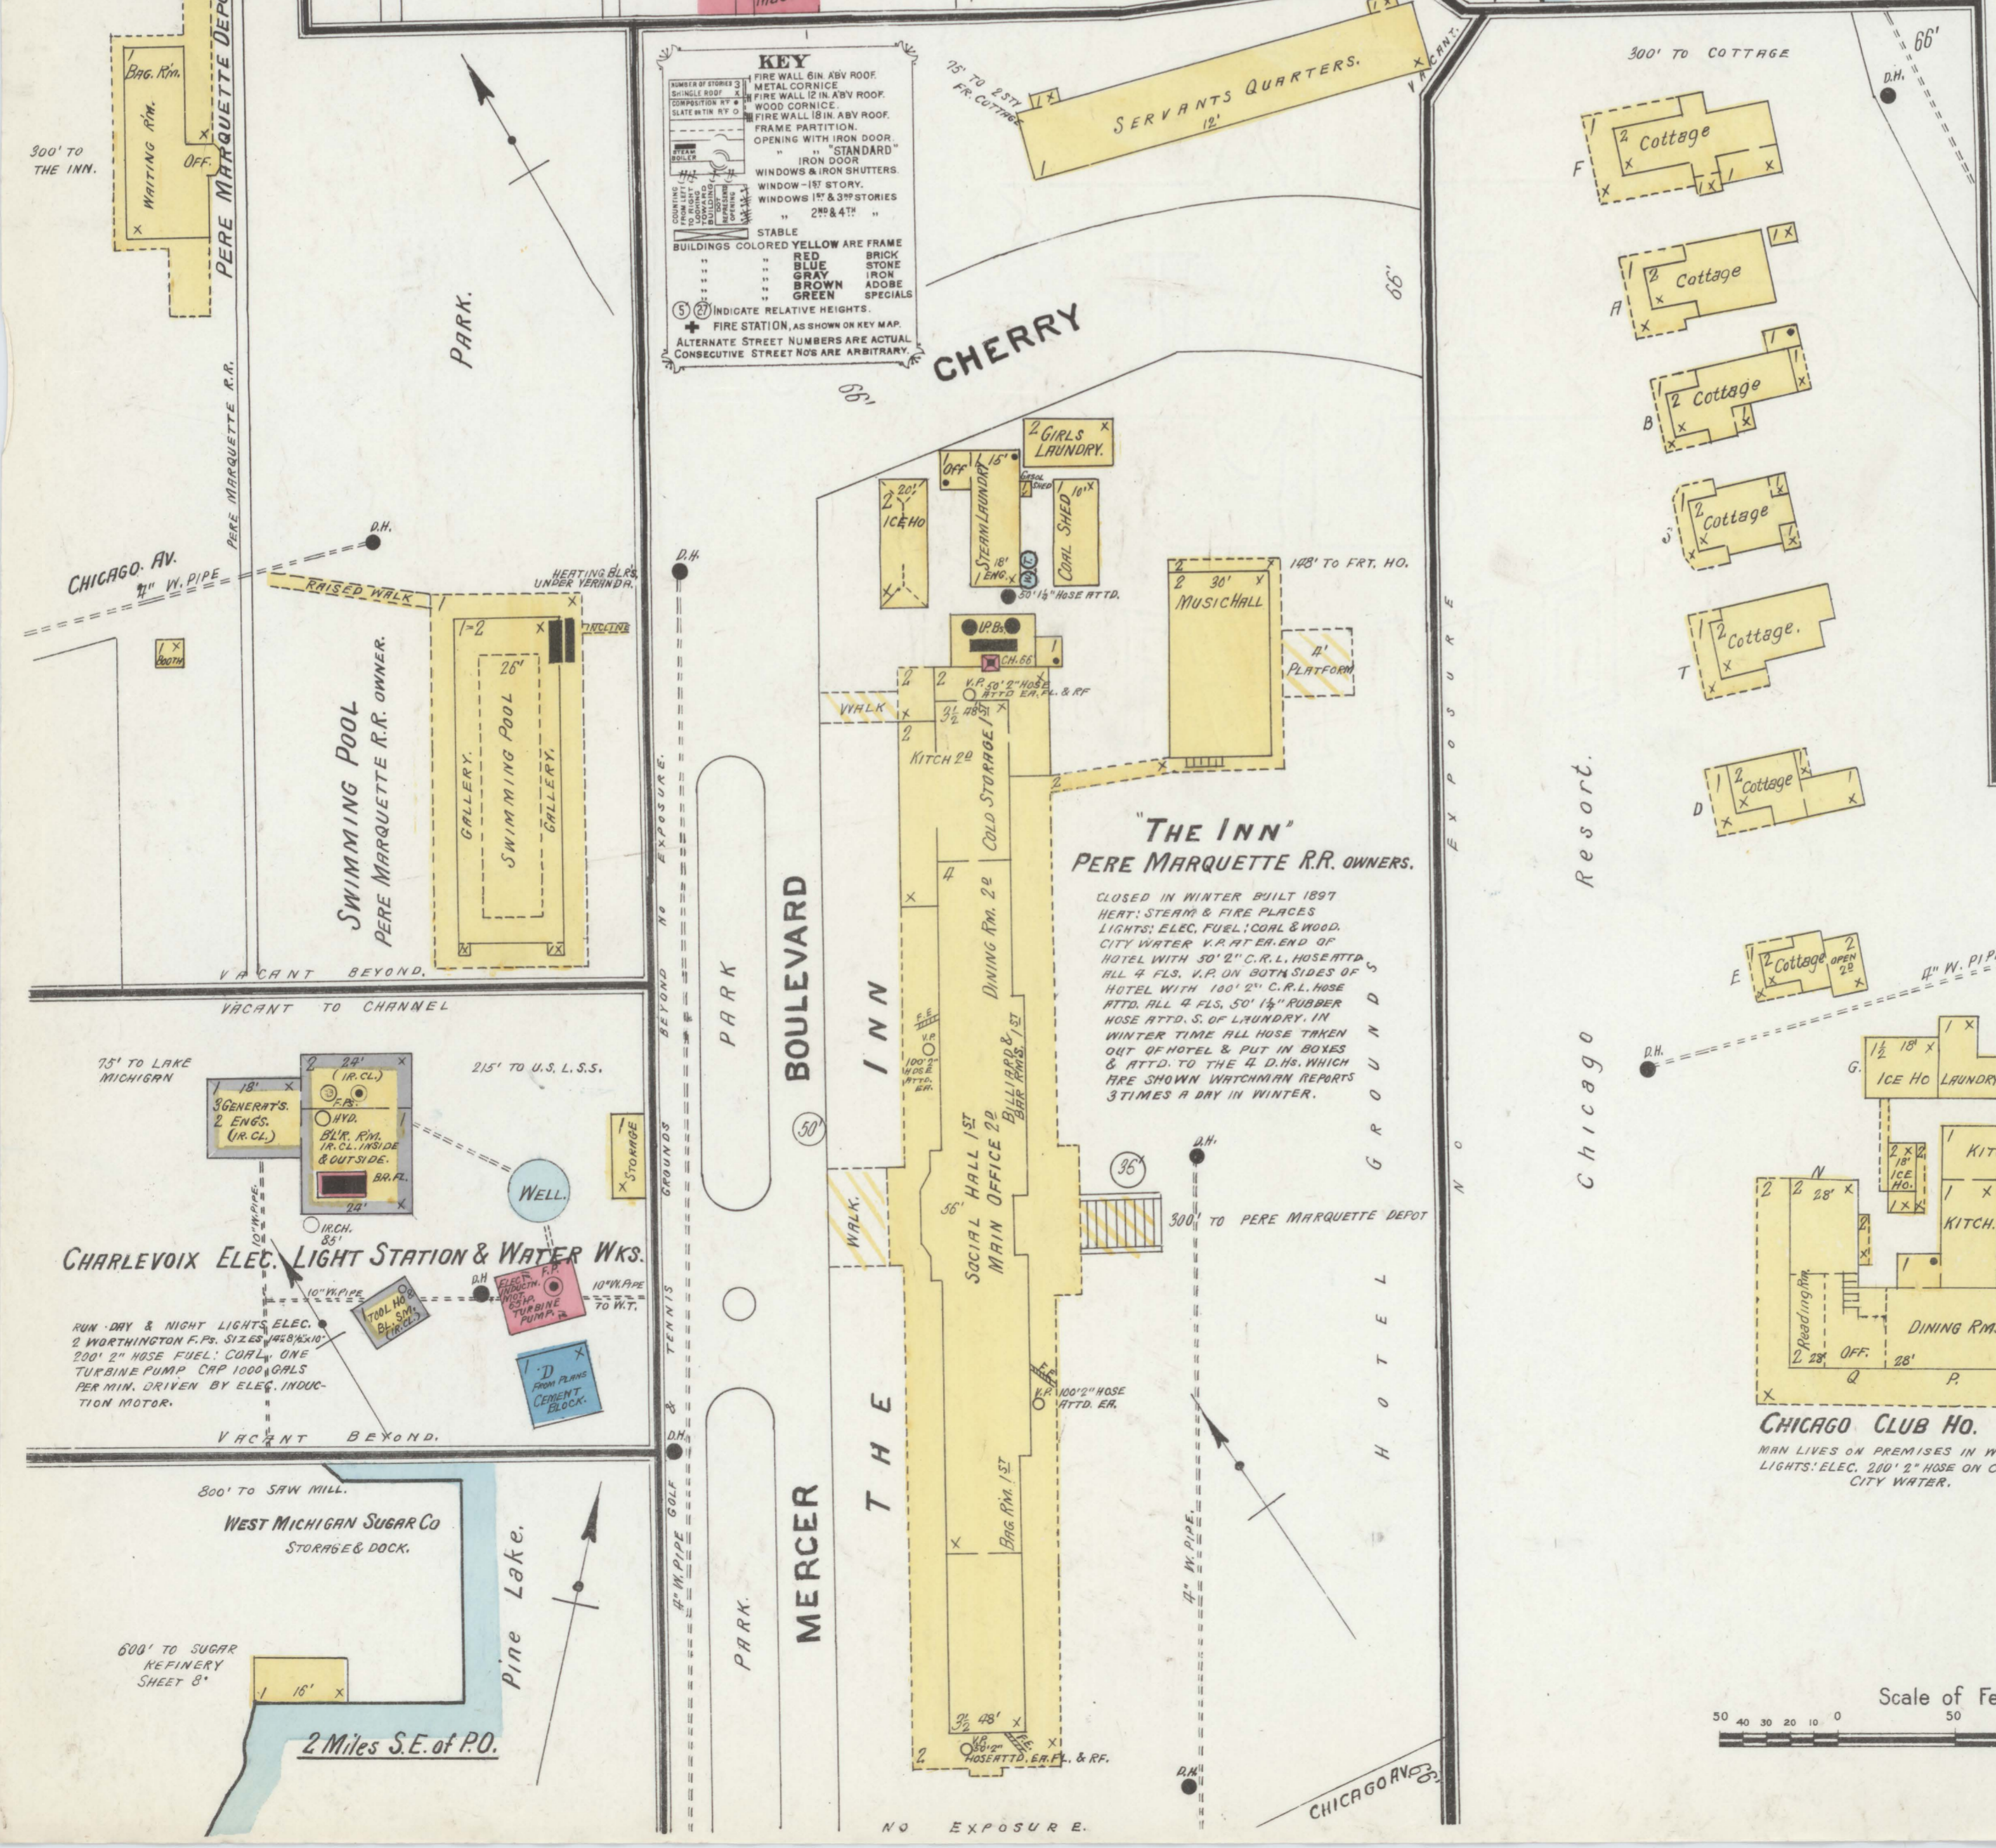

"THE INN"
PERE MARQUETTE R.R. OWNERS.

CLOSED IN WINTER BUILT 1897
HEAT: STEAM & FIRE PLACES
LIGHTS: ELEC. FUEL: COAL & WOOD.
CITY WATER K.R. AT END OF
HOTEL WITH 30" 2" C.R.L. HOSE ATTD
ALL 4 FLS. K.R. ON BOTH SIDES OF
HOTEL WITH 100' 2" C.R.L. HOSE
ATTD. ALL 4 FLS. 50' 1 1/2" RUBBER
HOSE ATTD. S. OF LAUNDRY. IN
WINTER TIME ALL HOSE TAKEN
OUT OF HOTEL & PUT IN BOXES
& ATTD. TO THE 42 D.Hs. WHICH
ARE SHOWN WATCHMAN REPORTS
3 TIMES A DRY IN WINTER.

CHICAGO CLUB HO.
MAN LIVES ON PREMISES IN WINTER
LIGHTS: ELEC. 2 1/2" HOSE ON CHART
CITY WATER.

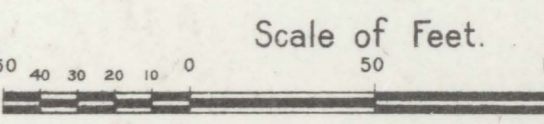


Division
29 JUL 1955
Library of Congress


6

JUNE 1907
CHARLEVOIX
MICH.

6

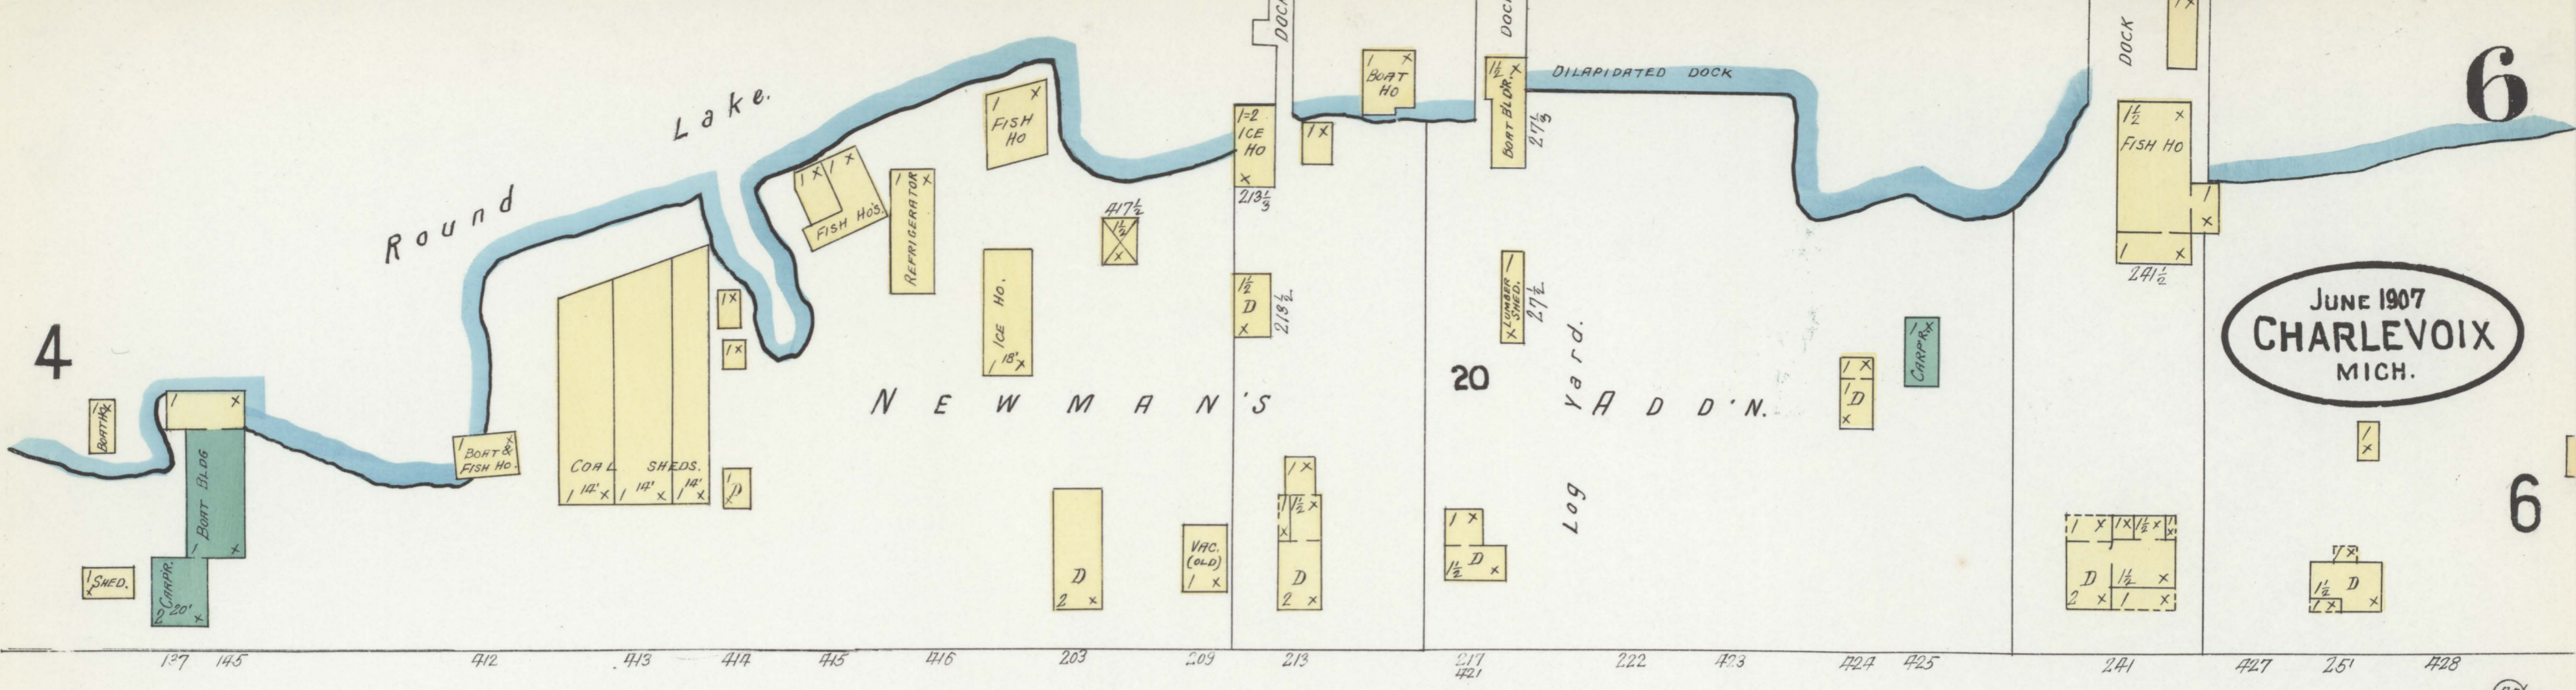


E. NEWMAN

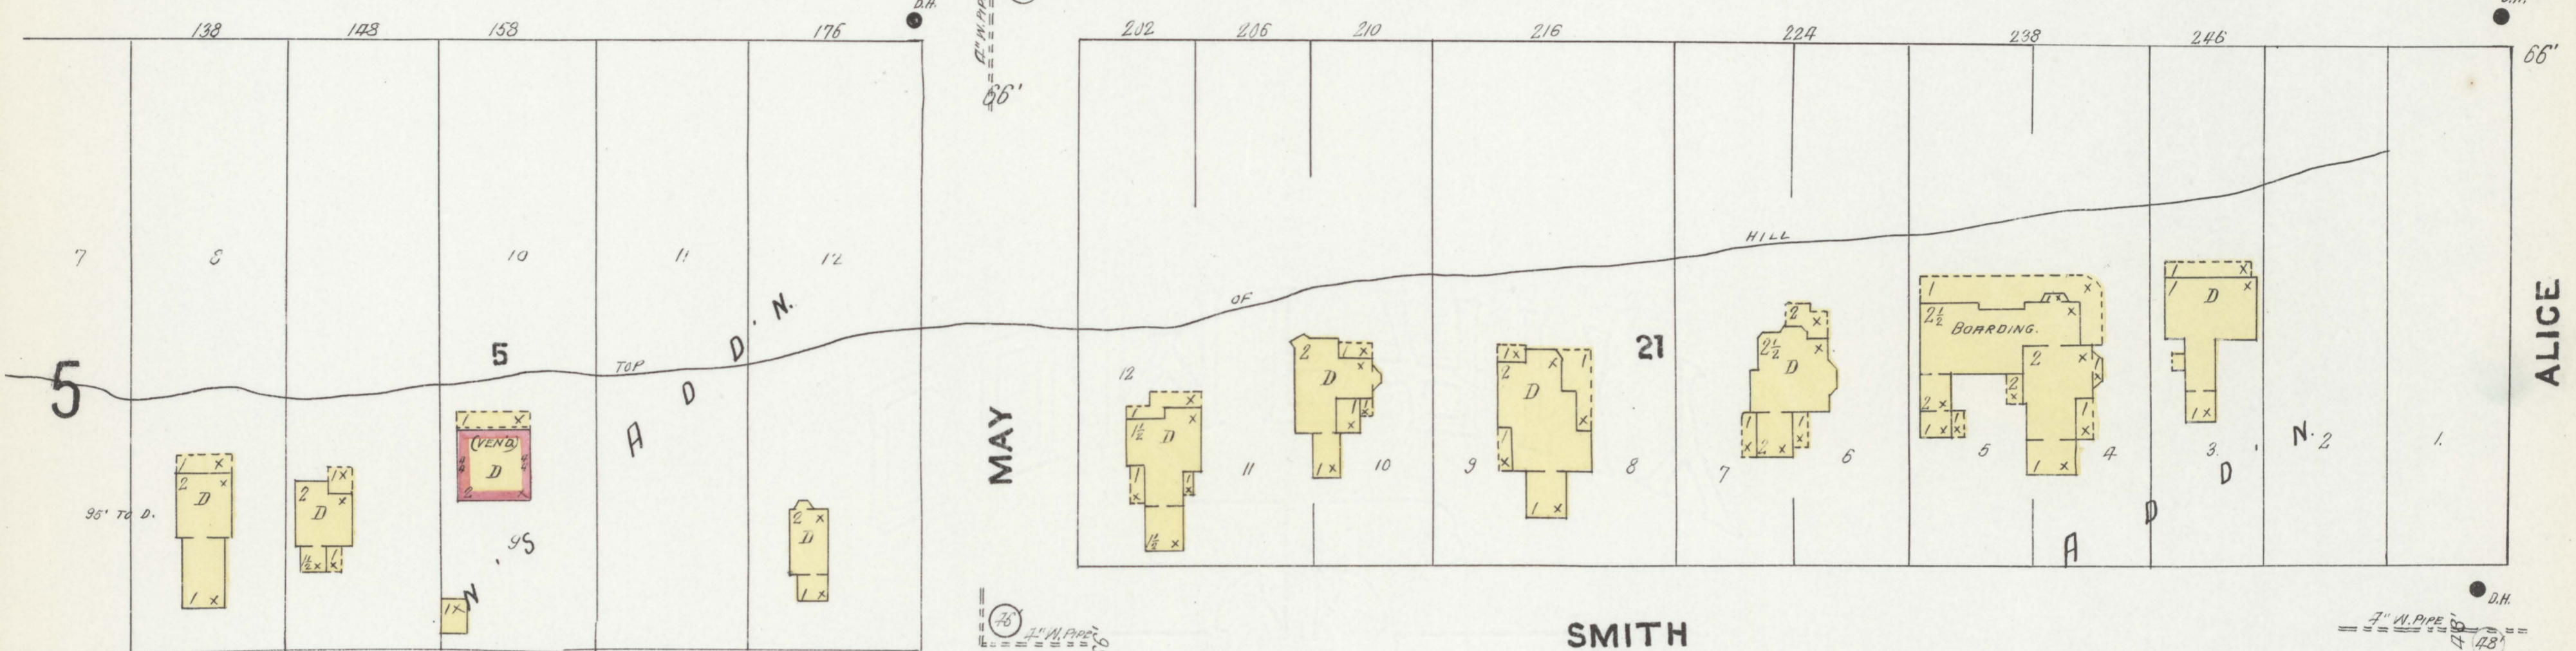


ALICE

MAY

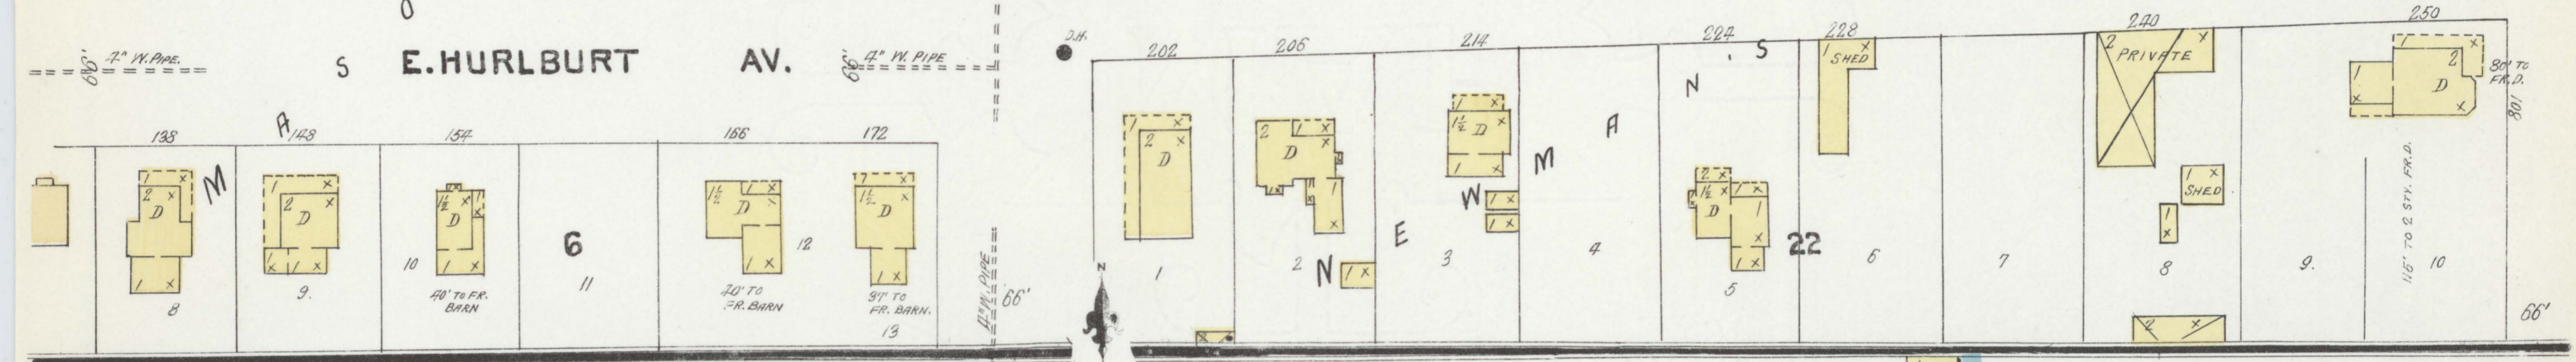

SMITH

E. HURLBURT

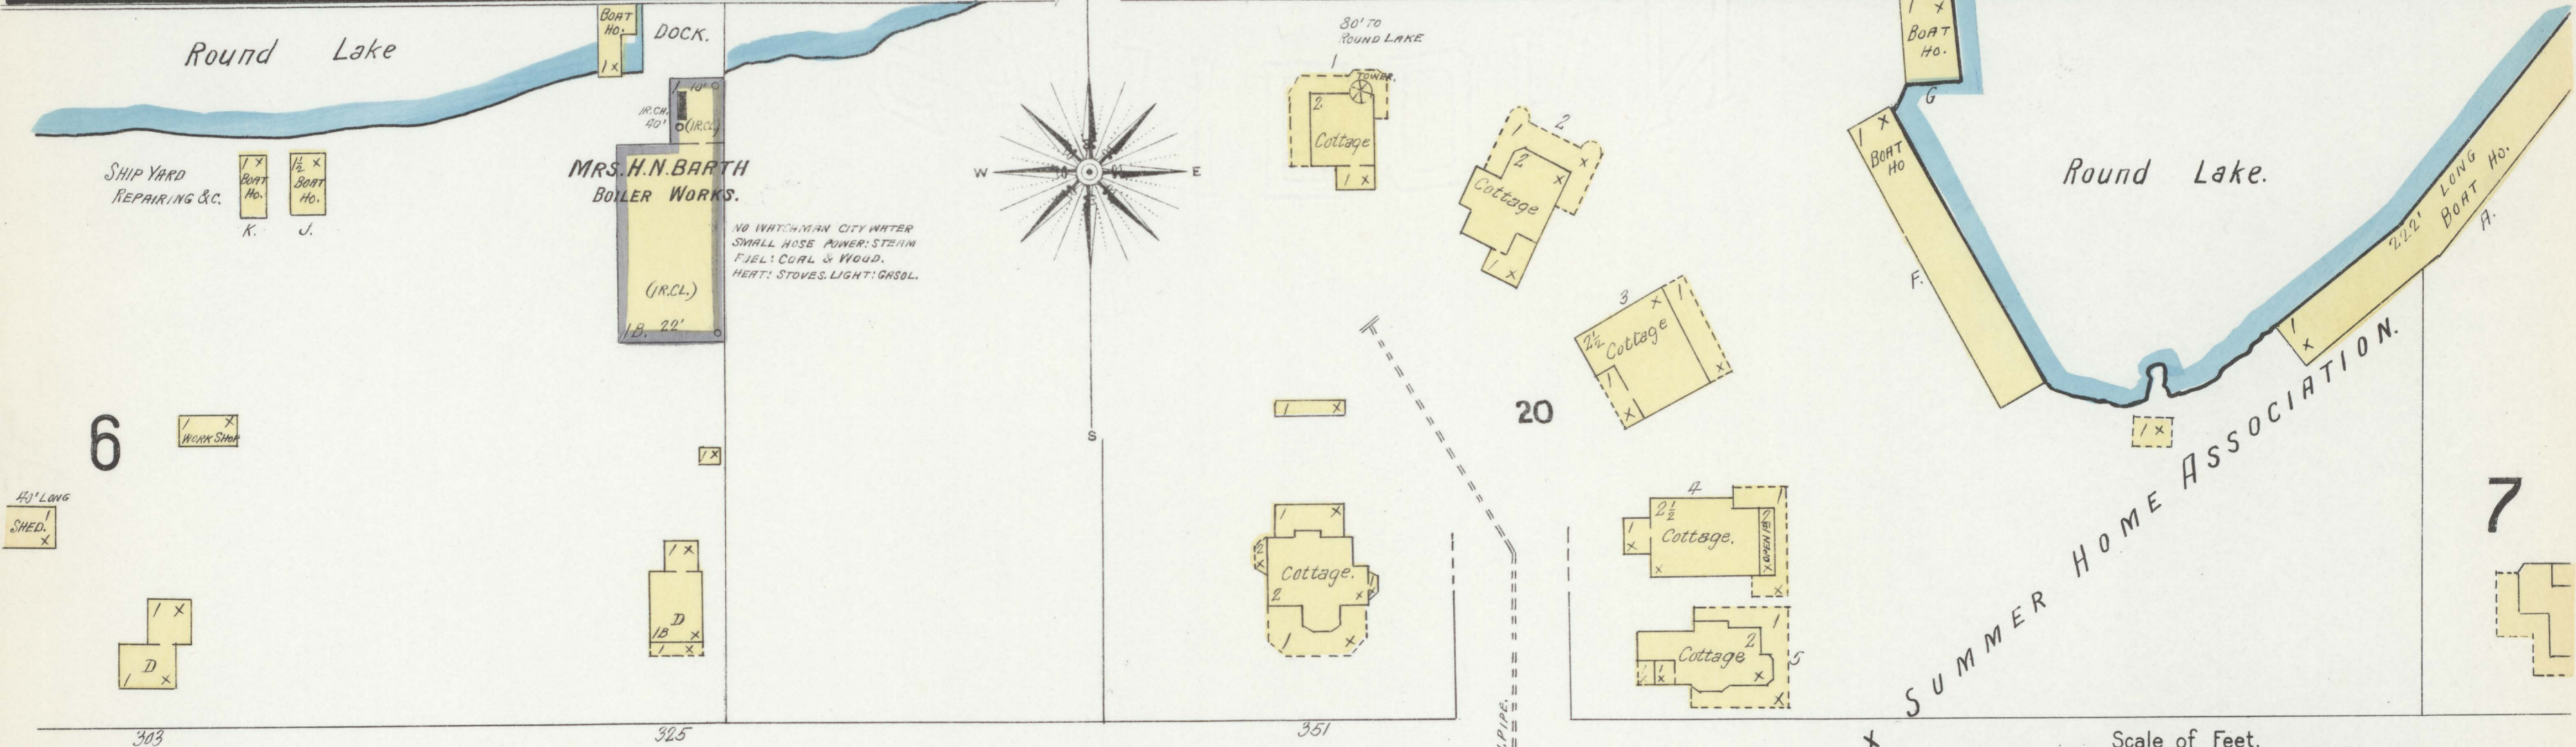


MRS. H.N. BARTH
BOILER WORKS.

Round Lake.

CHARLEVOIX SUMMER HOME ASSOCIATION.

E. NEWMAN

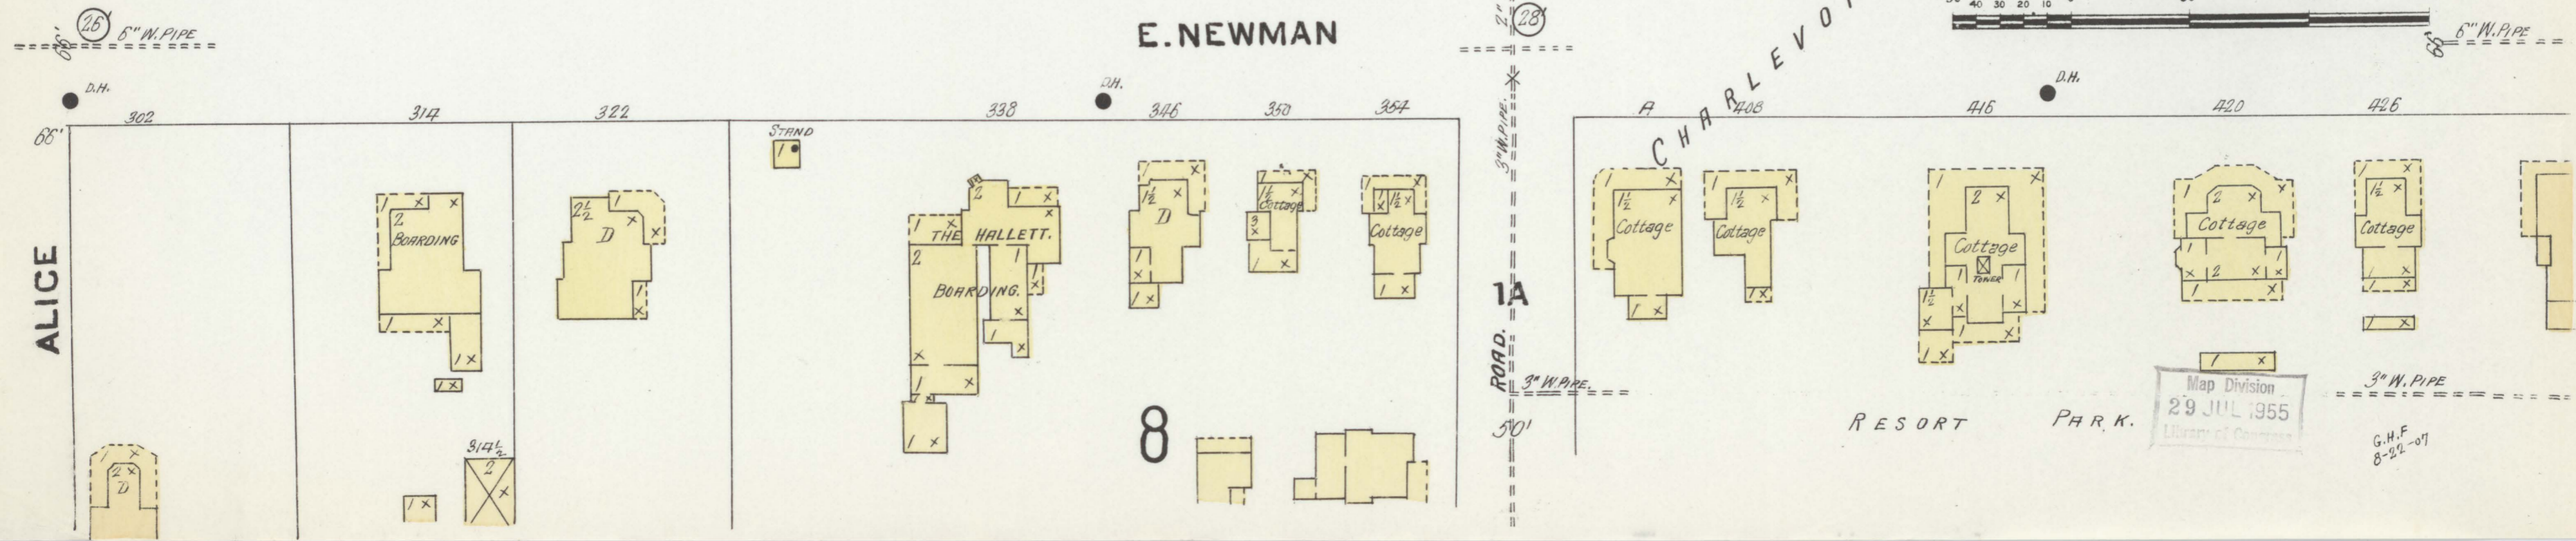

ALICE







8

RESORT PARK.

Map Division
29 JUL 1955
Library of Congress

G.H.F. 8-24-07




Scale of Feet.

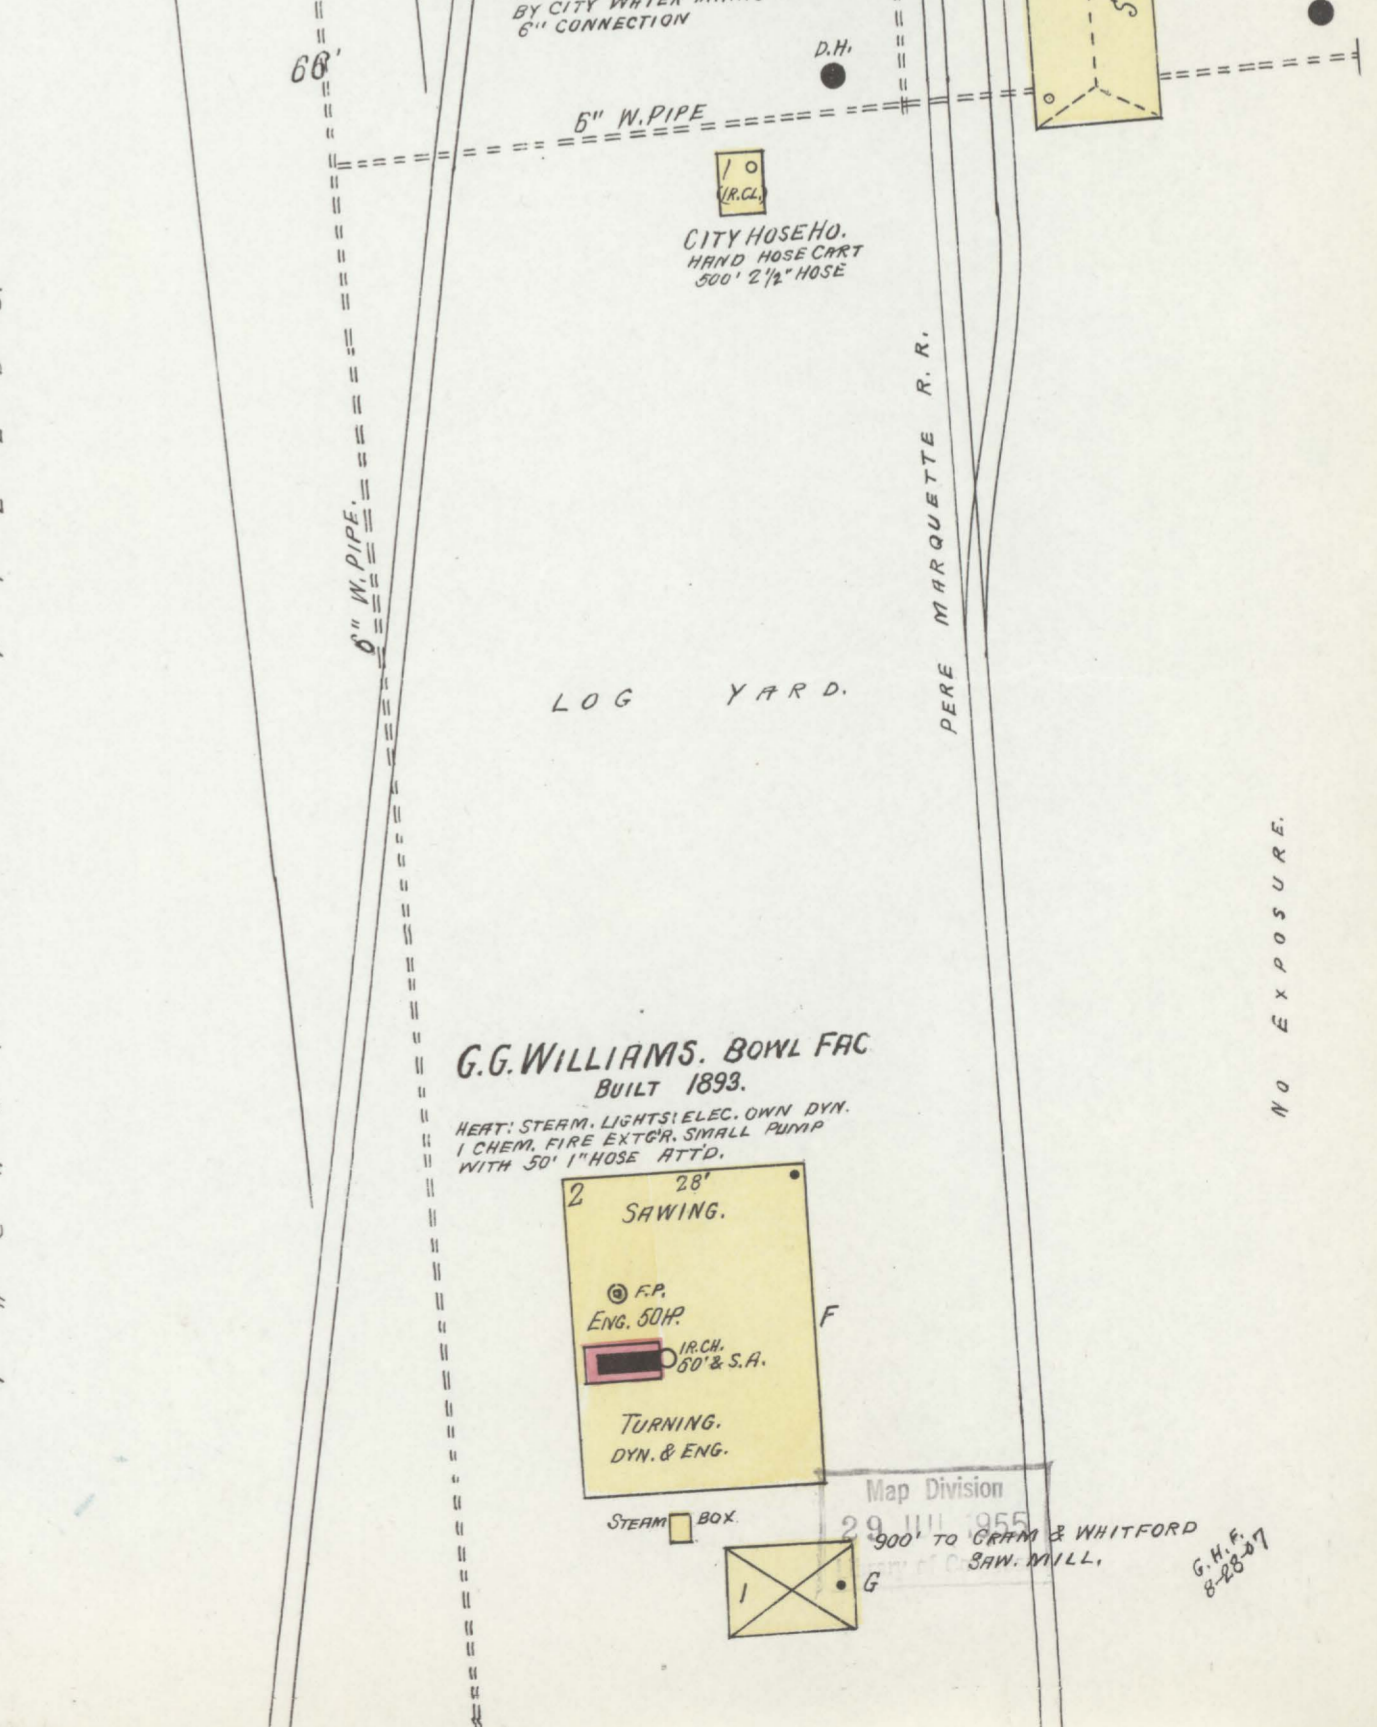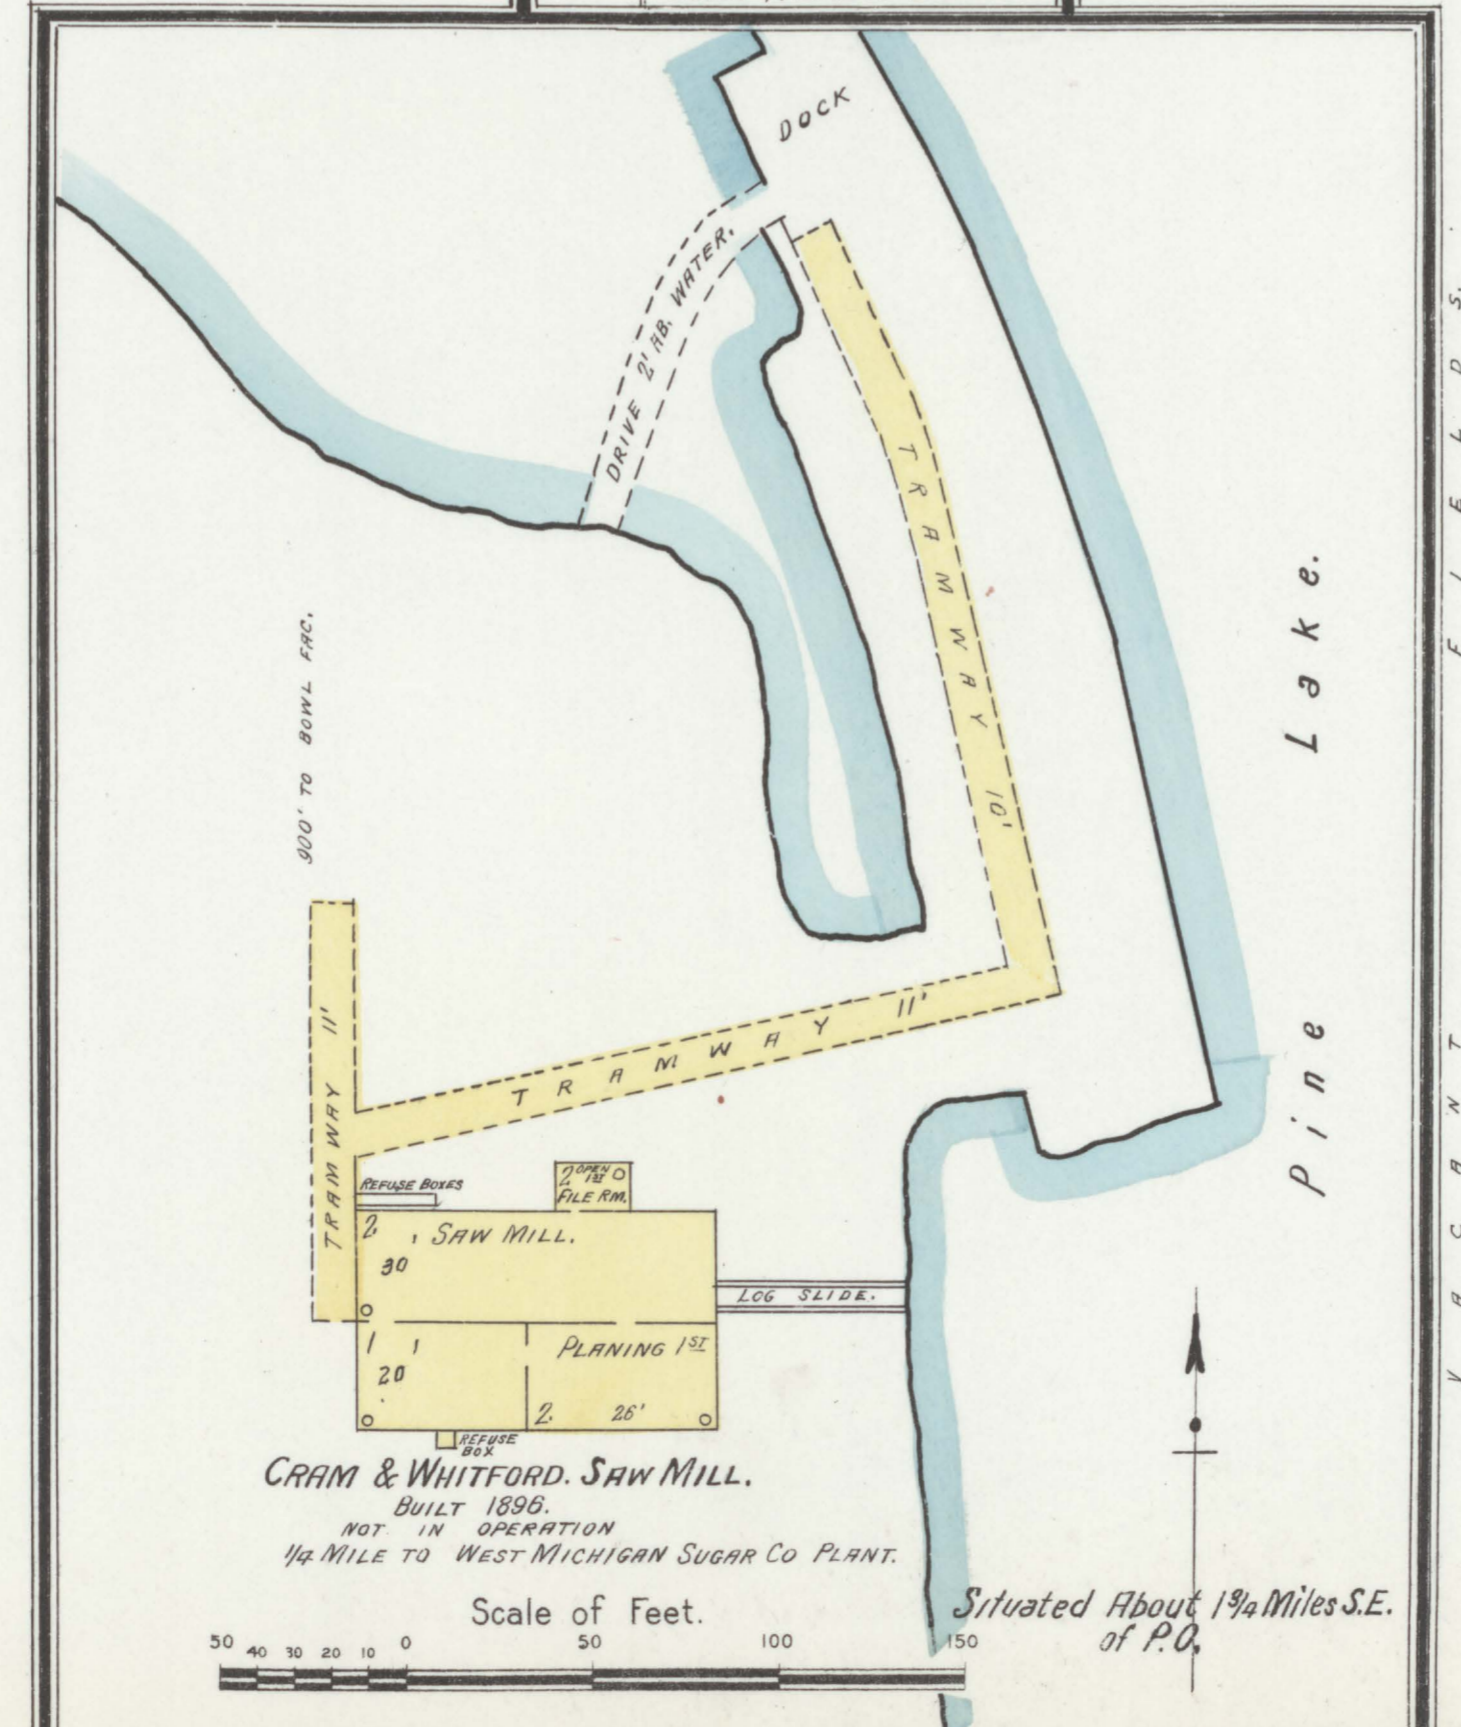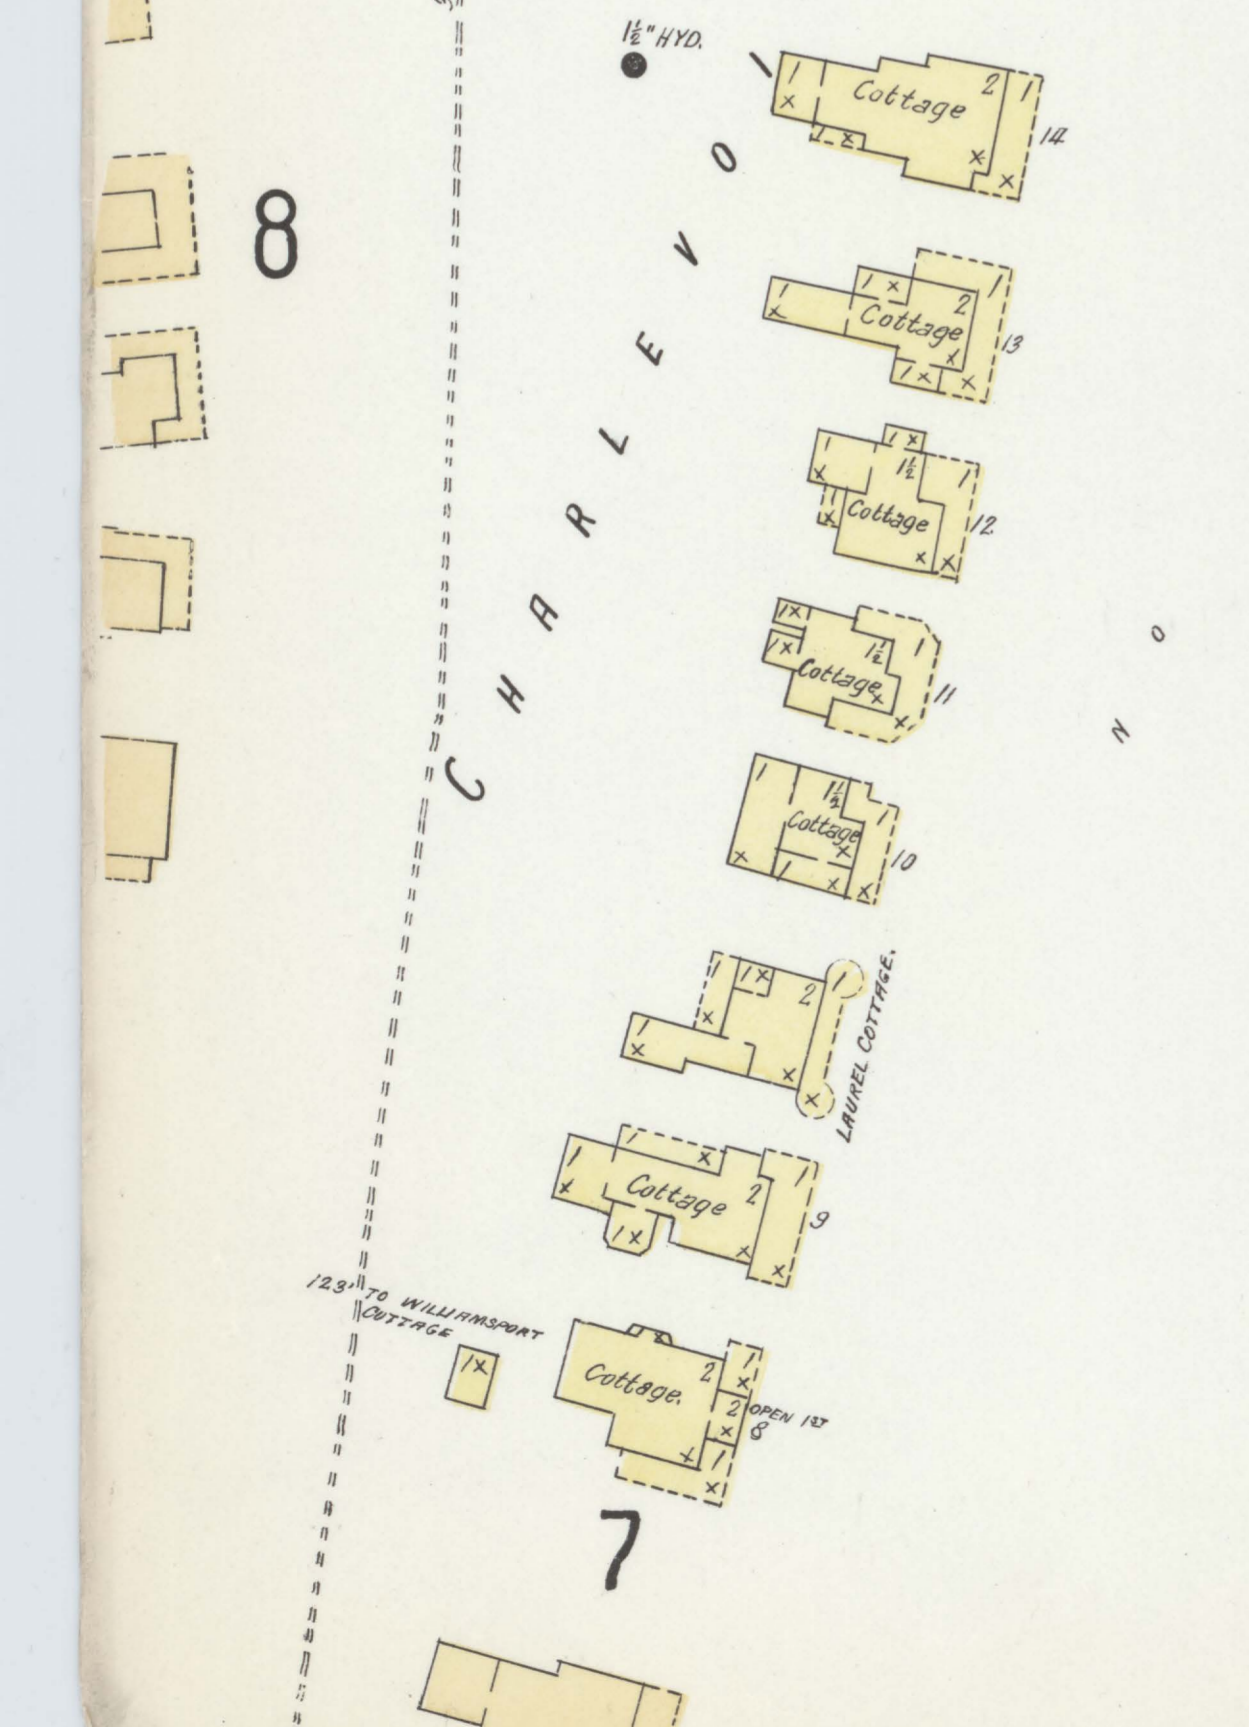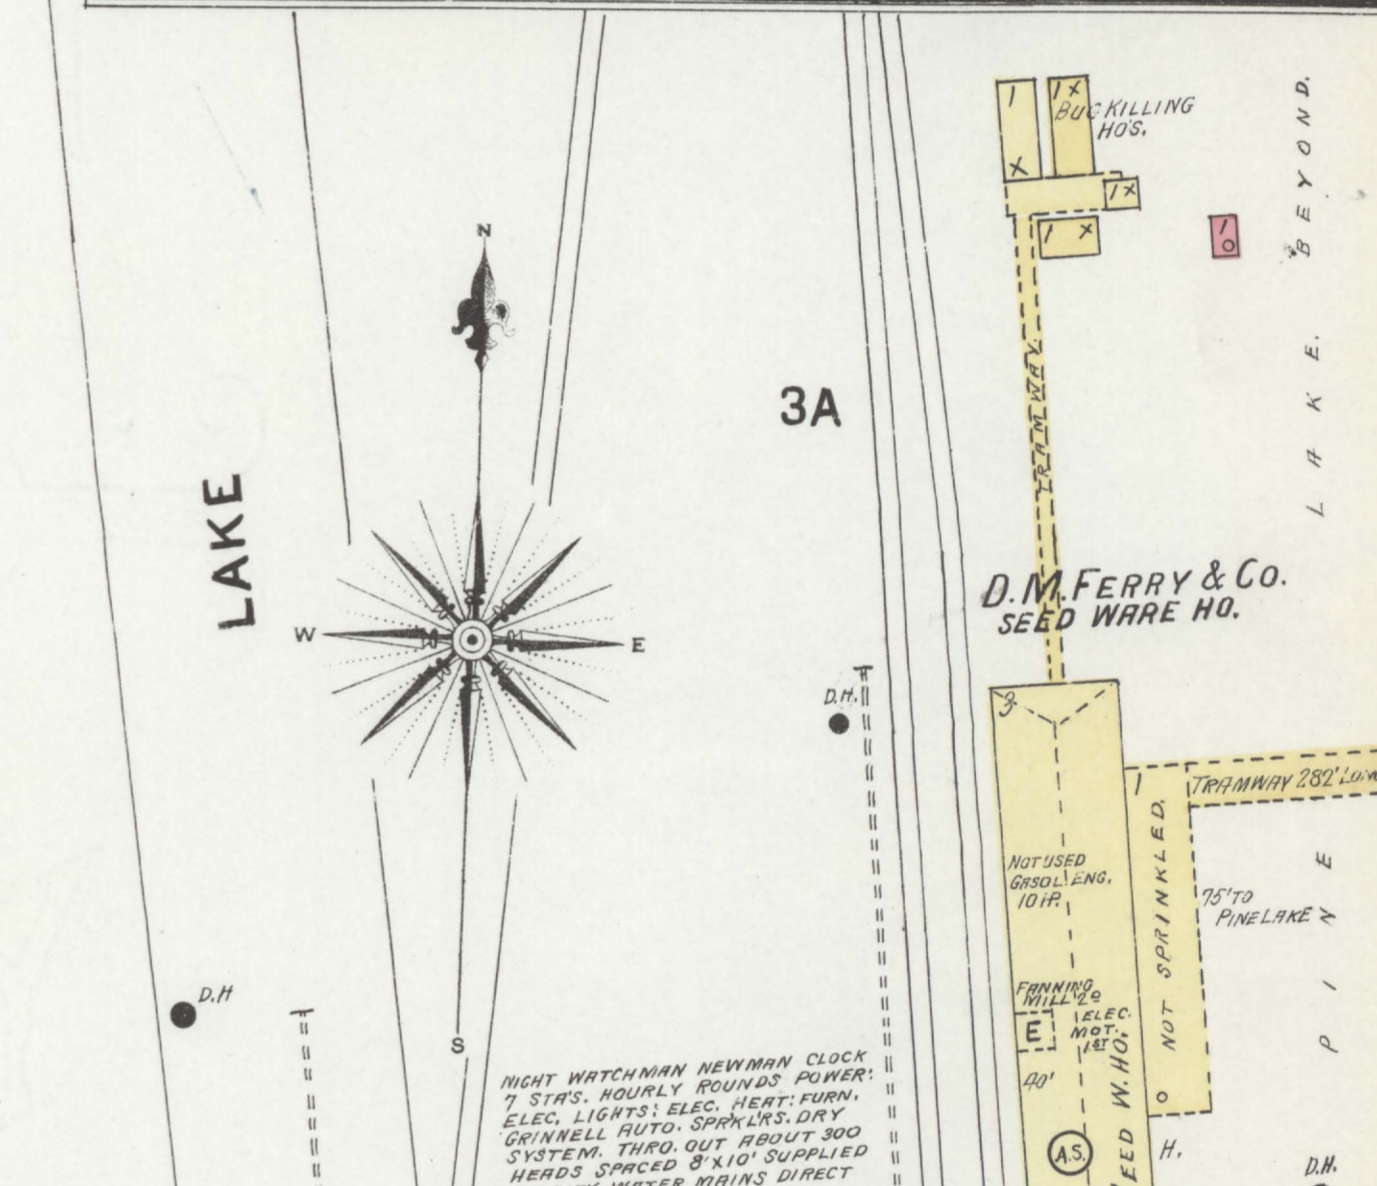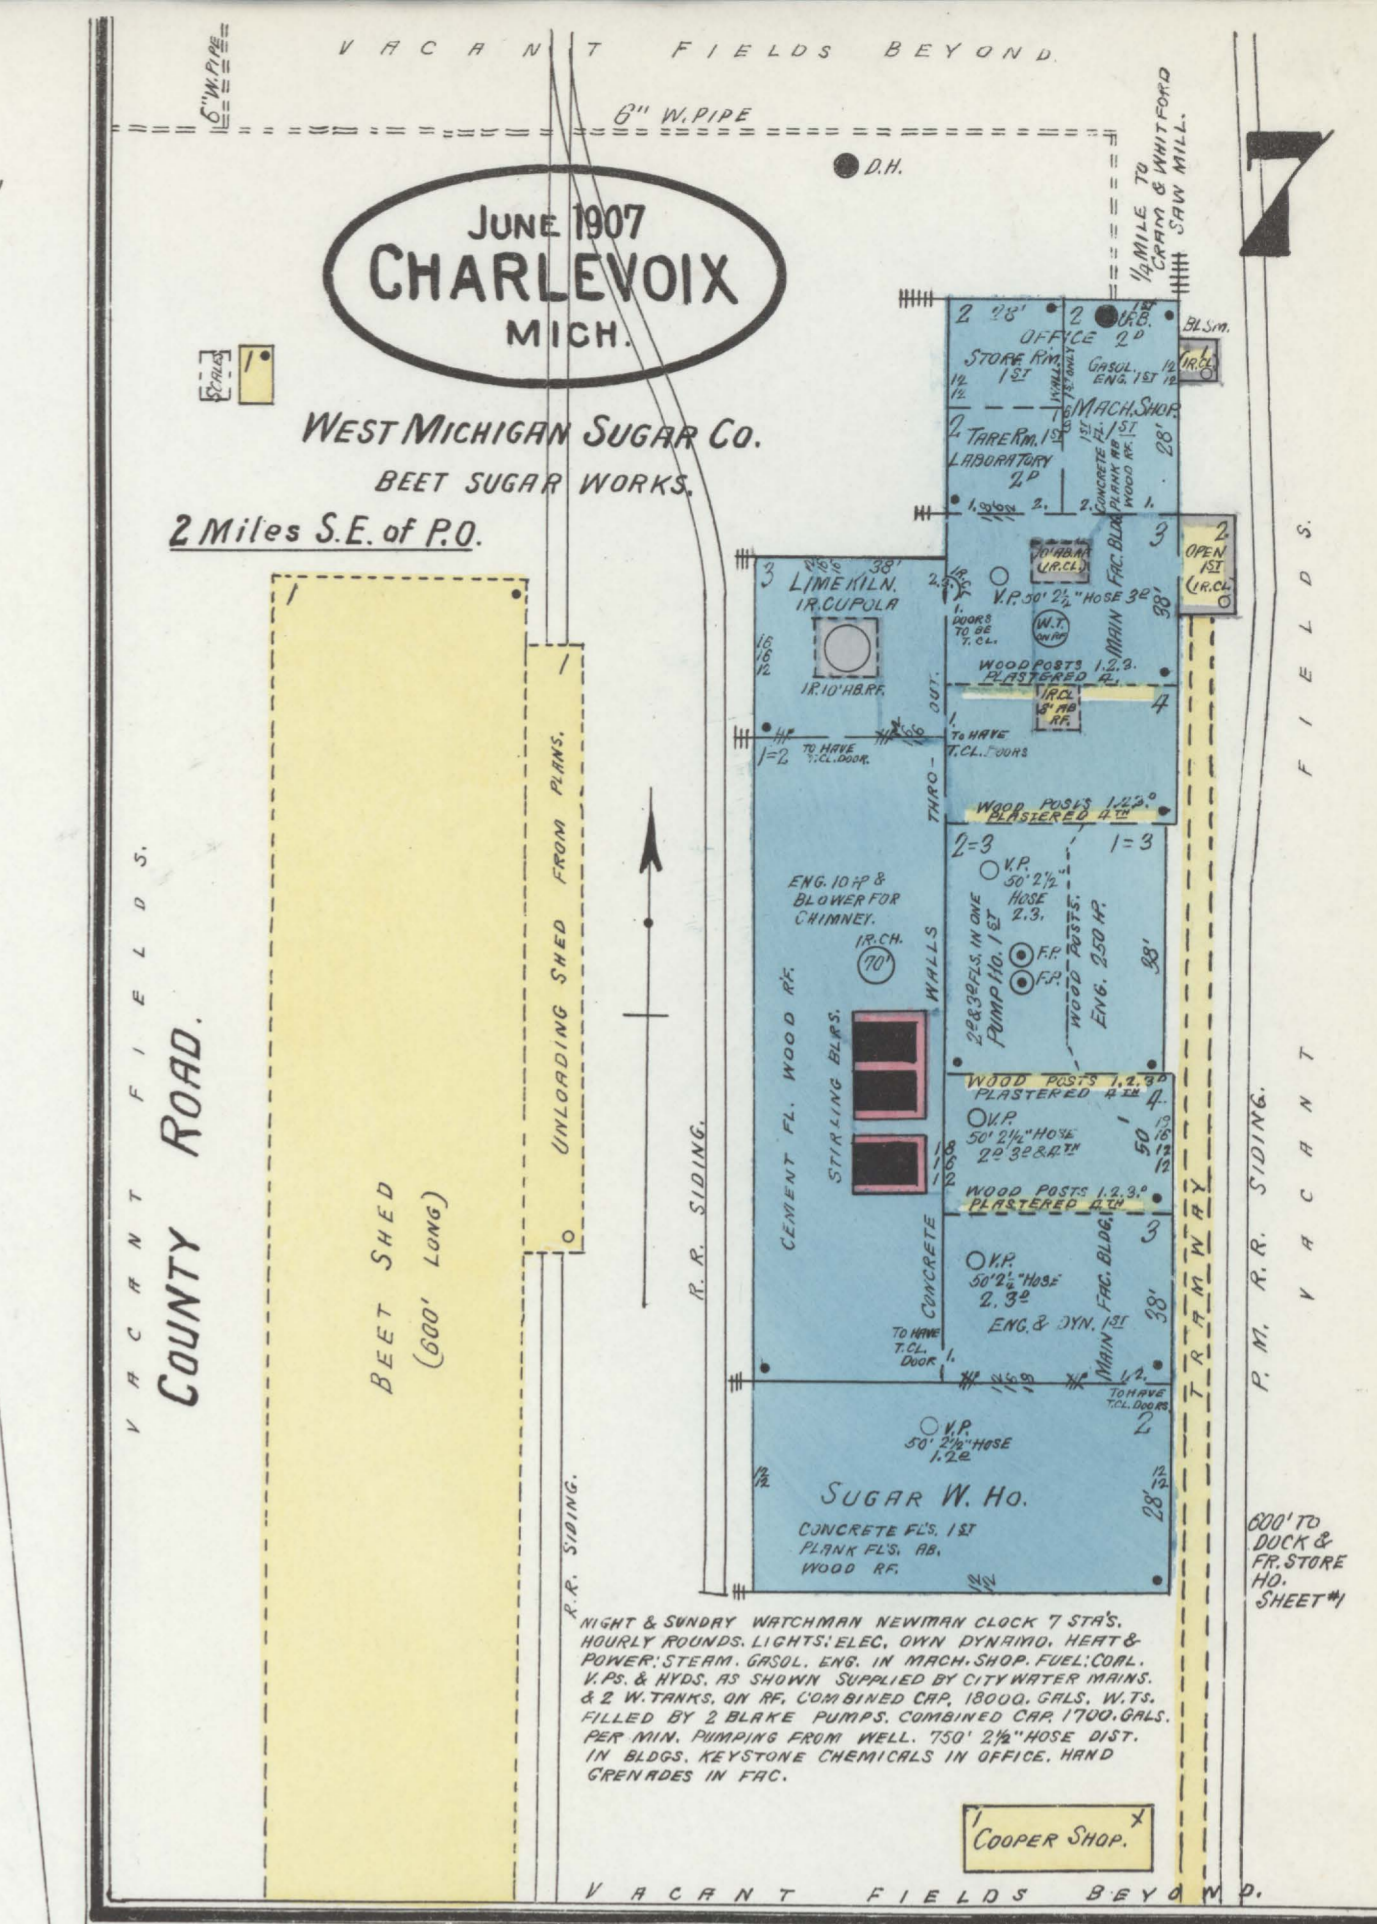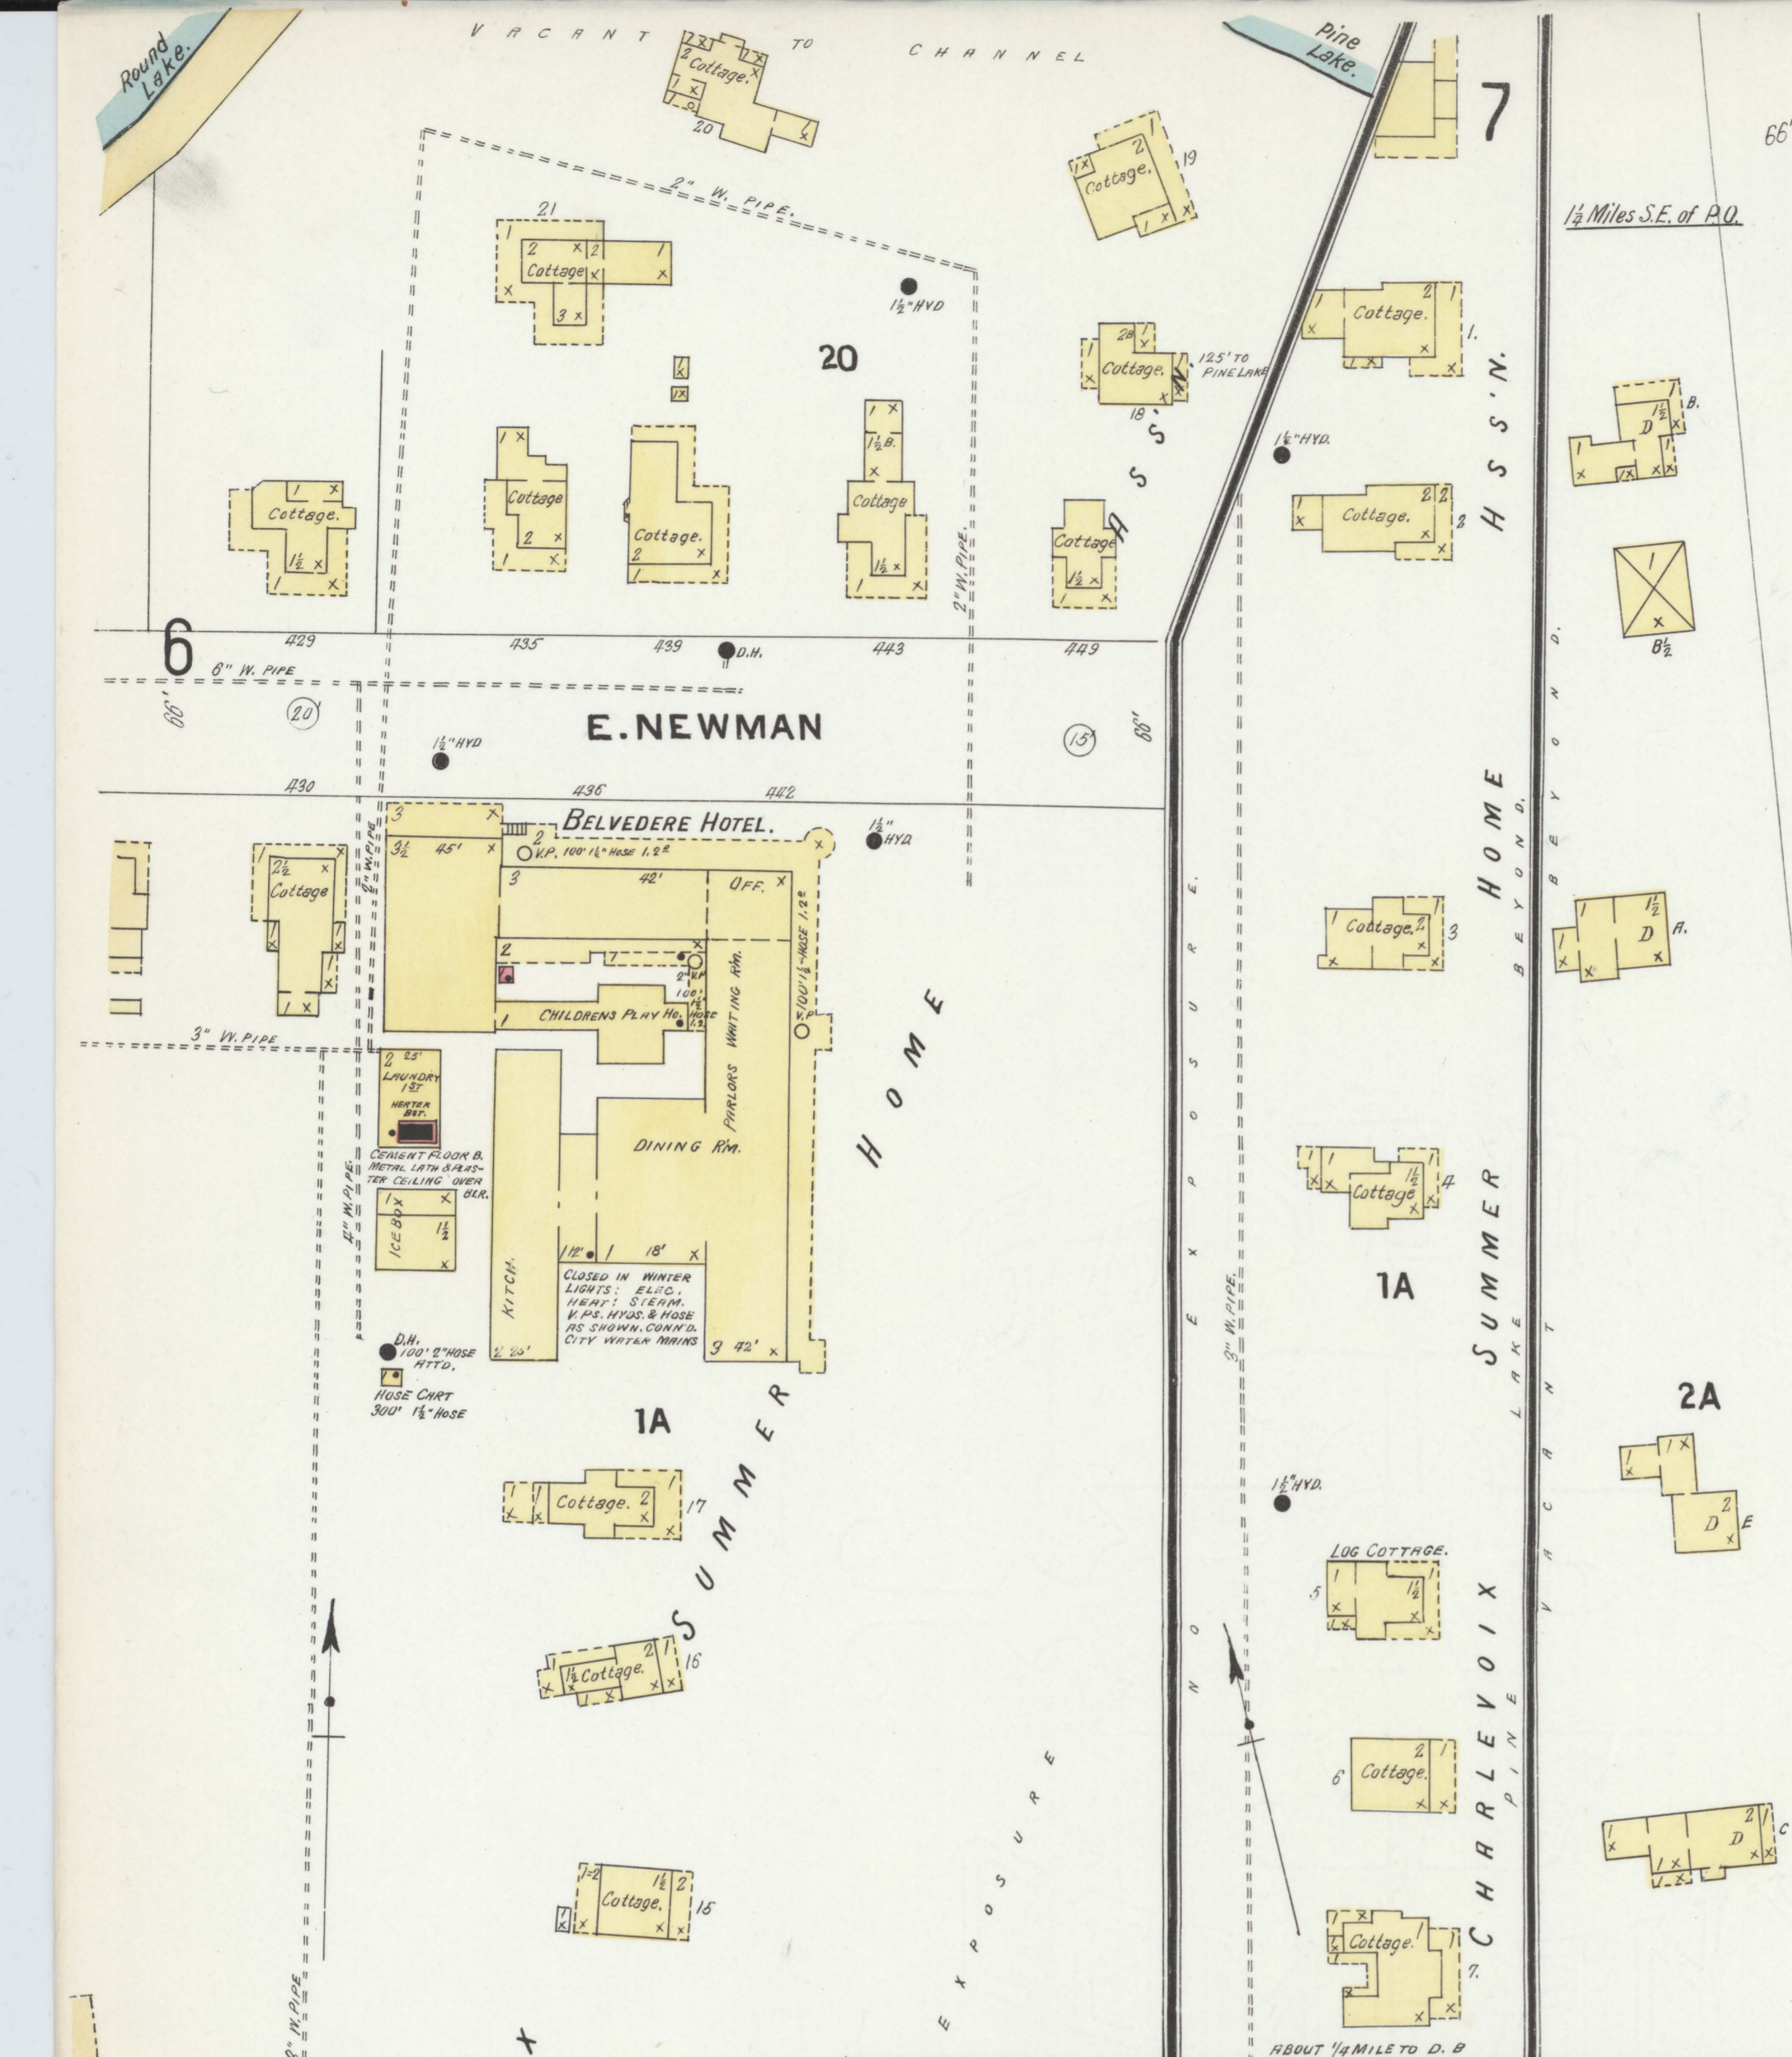

JUNE 1907
CHARLEVOIX
MICH.


OMENA
LEE LANAU COUNTY
MICHIGAN
*About 36 Miles S. of Charlevoix
on Grand Traverse Bay.*
PREV. WINDS: S. POPULATION 300.
NO FIRE APP.

VACANT BEYOND.

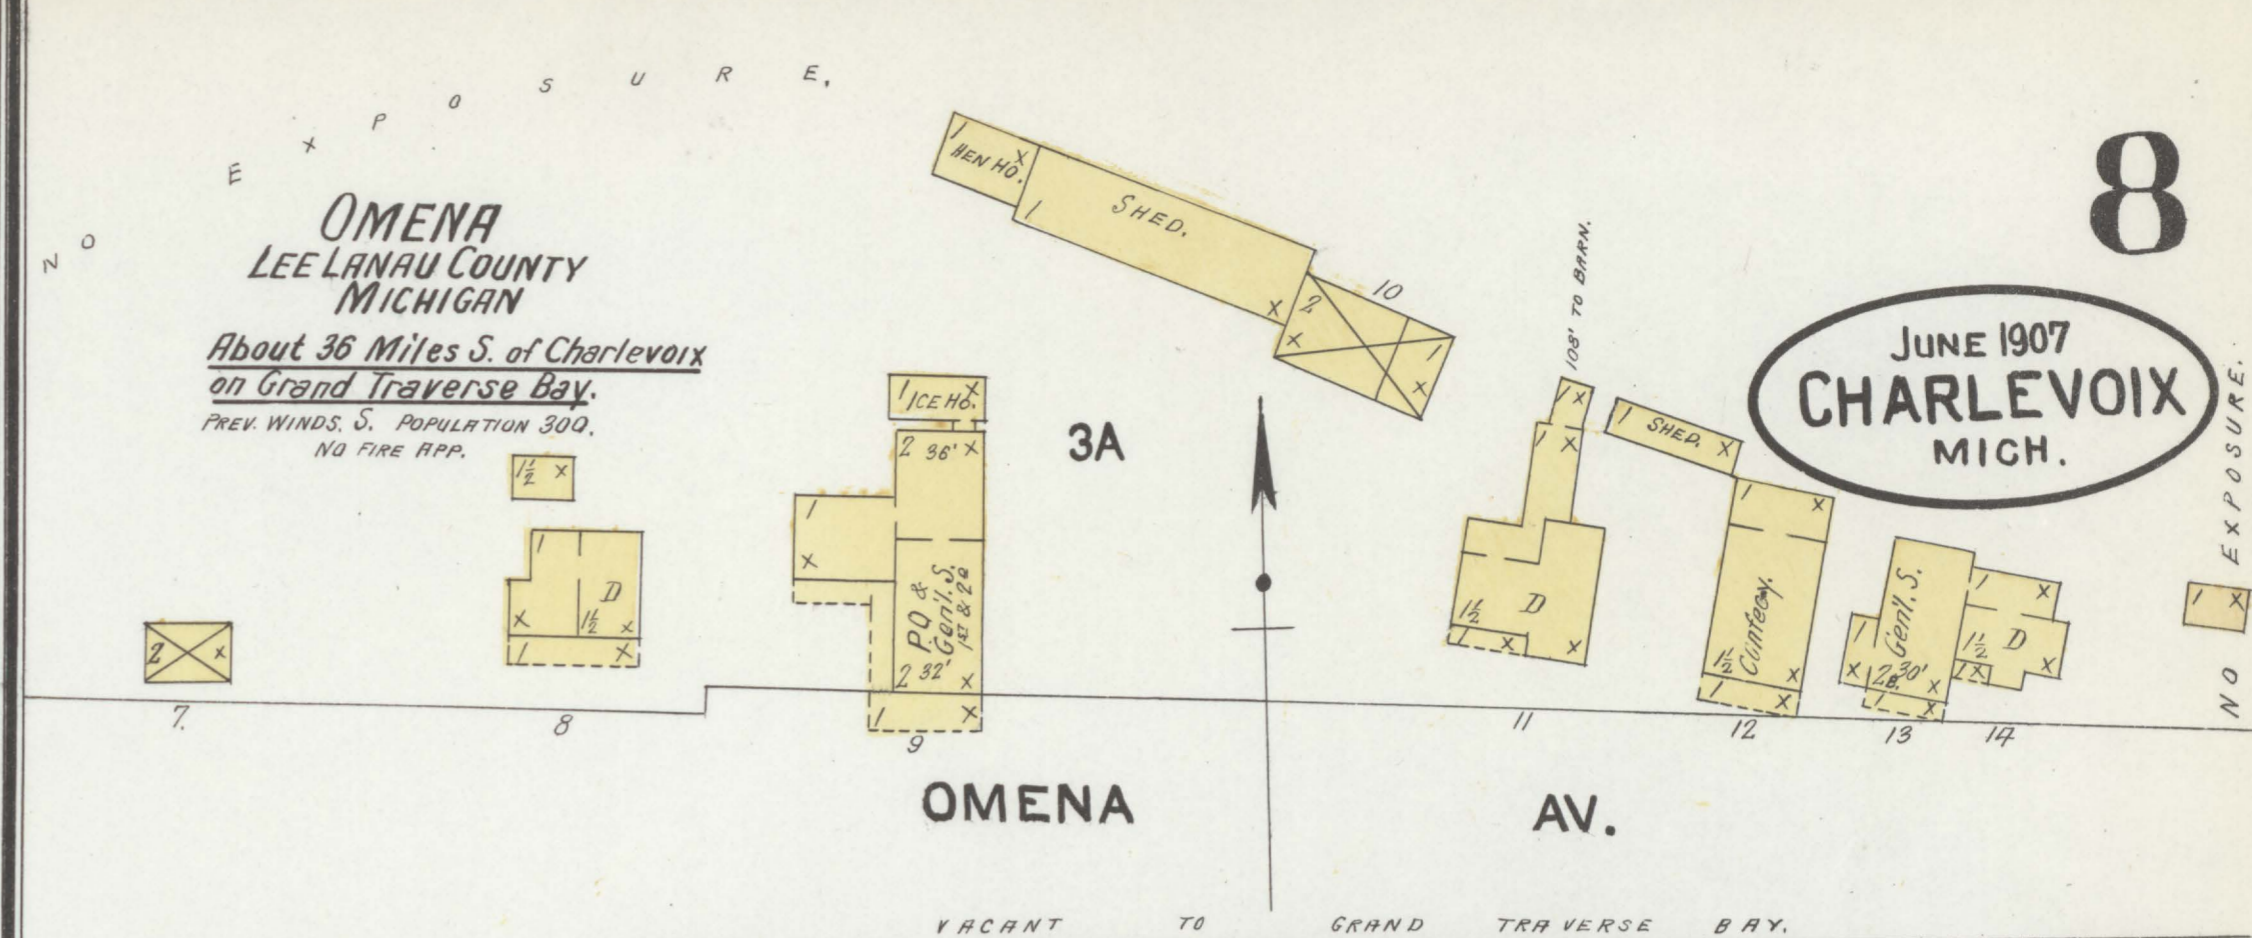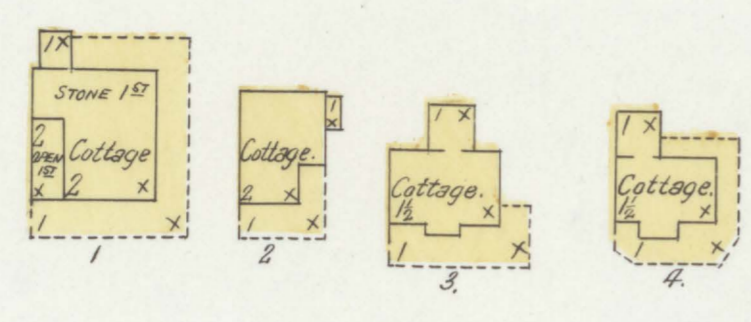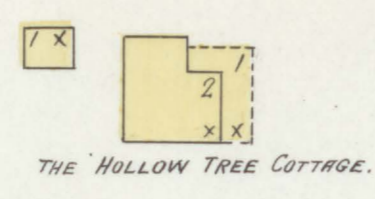

OMENA AV.



VACANT TO GRAND TRAVERSE BAY.





2A

LEE LANAU HOTEL.

WATER PAILS IN HALLWAYS
LIGHTS, GAS, HEAT, STOVES
CLOSED IN WINTER. MAIN LIVES
ON PREMISES IN WINTER.

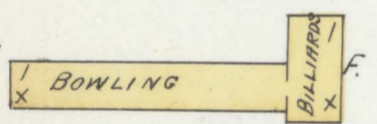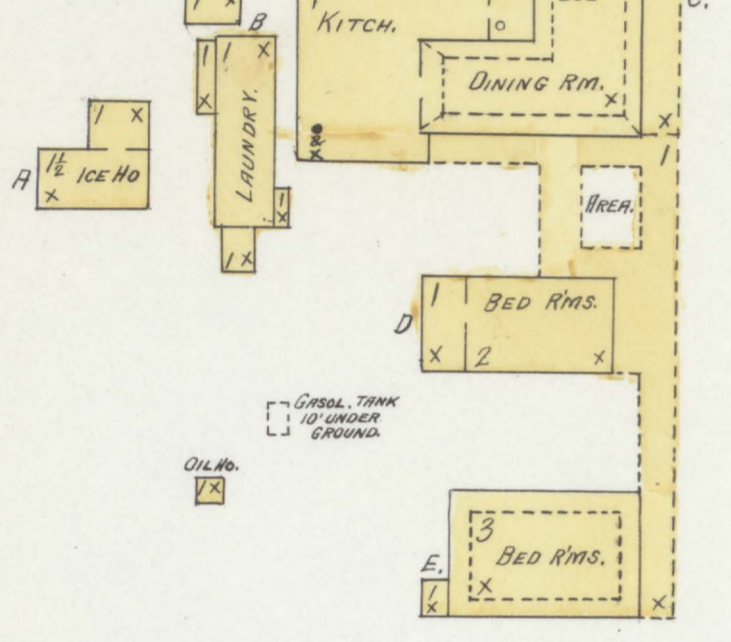

1 Mile S.E. of Omena P.O.

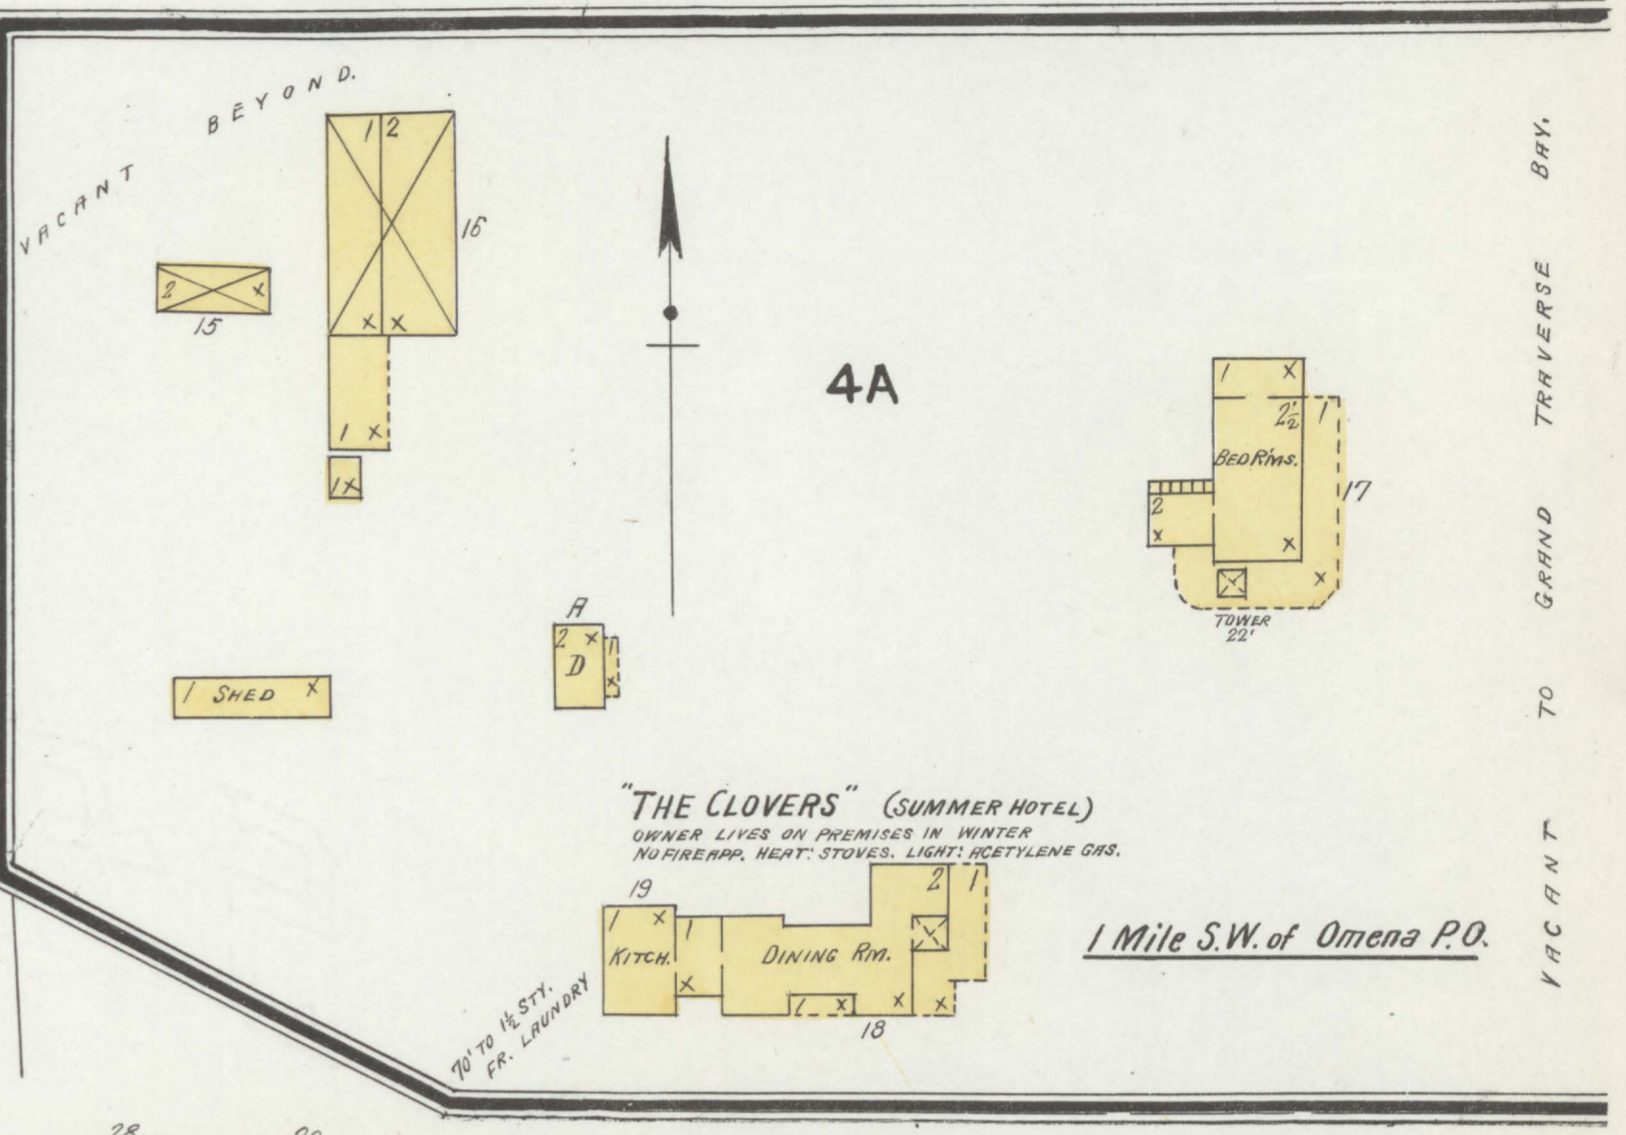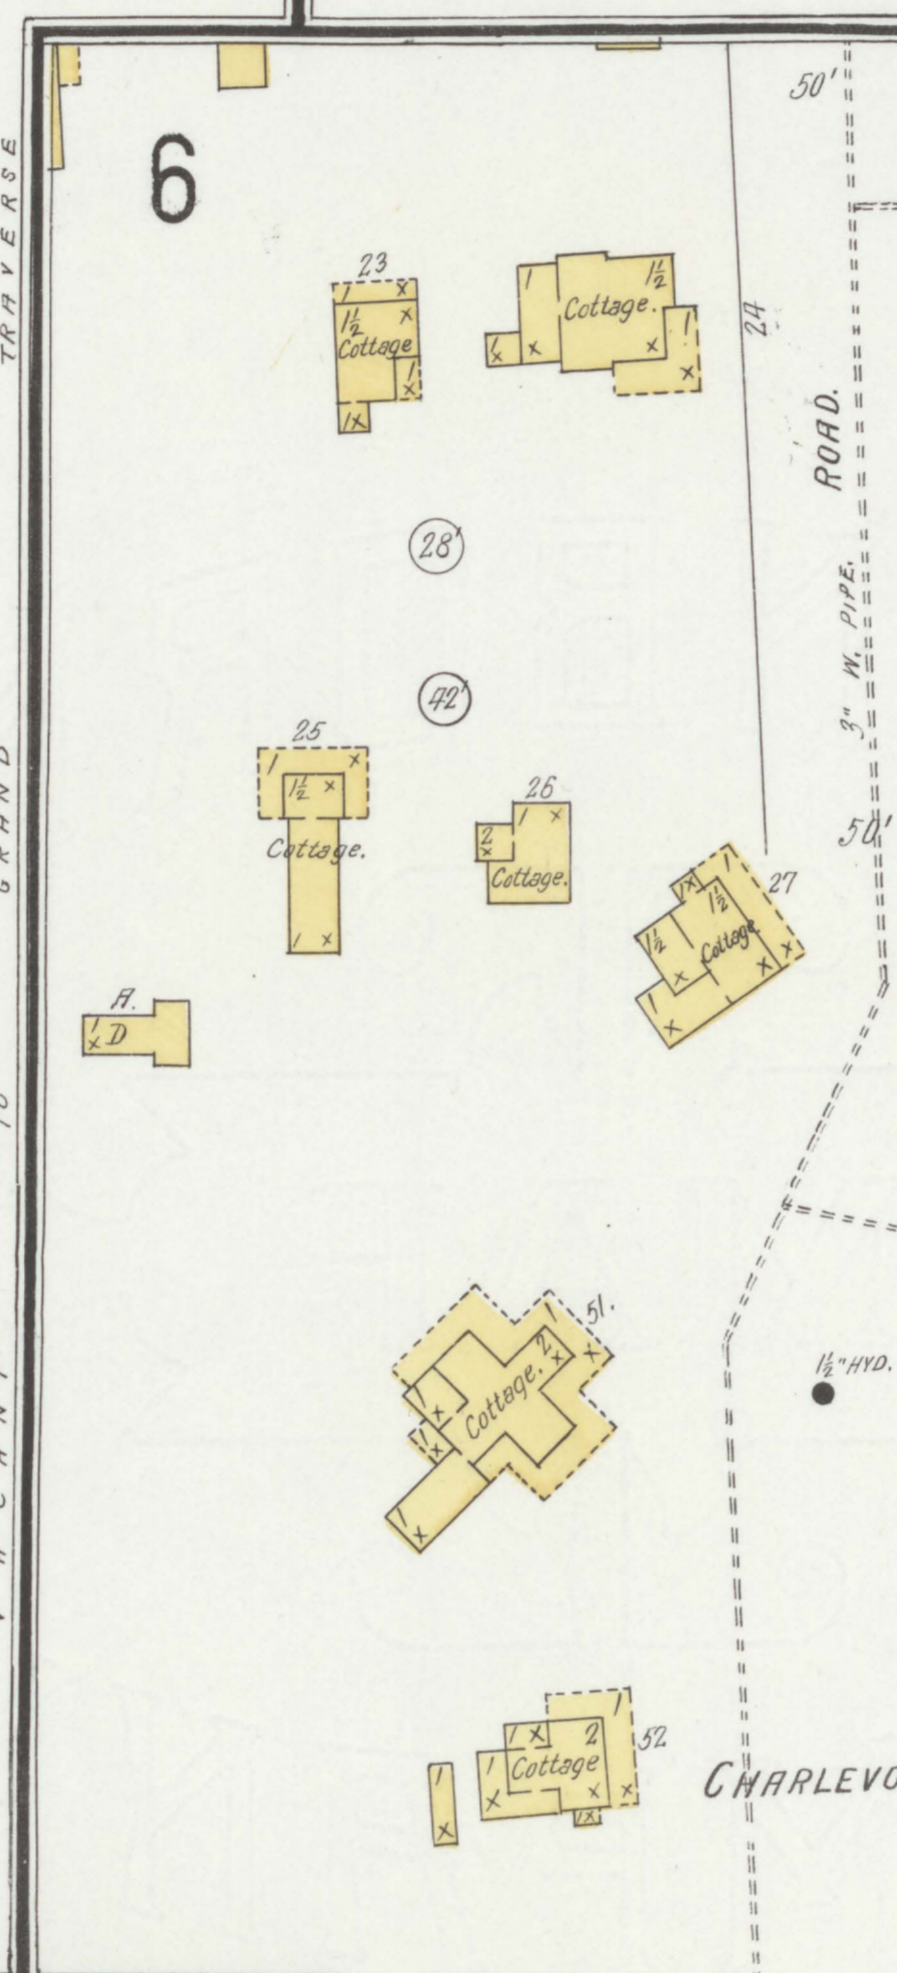




"THE CLOVERS" (SUMMER HOTEL)
OWNER LIVES ON PREMISES IN WINTER.
NO FIRE APP. HEAT: STOVES. LIGHT: KETTLETYPE GAS.

1 Mile S.W. of Omena P.O.

CHARLEVOIX SUMMER HOME ASSOCIATION.

Park.
Pavilion

1A

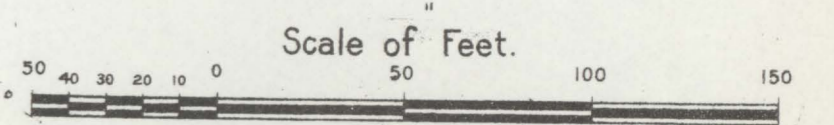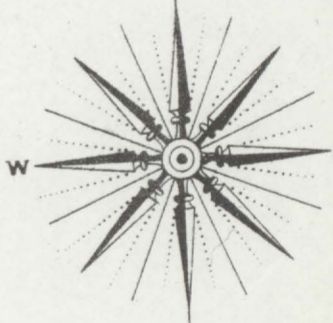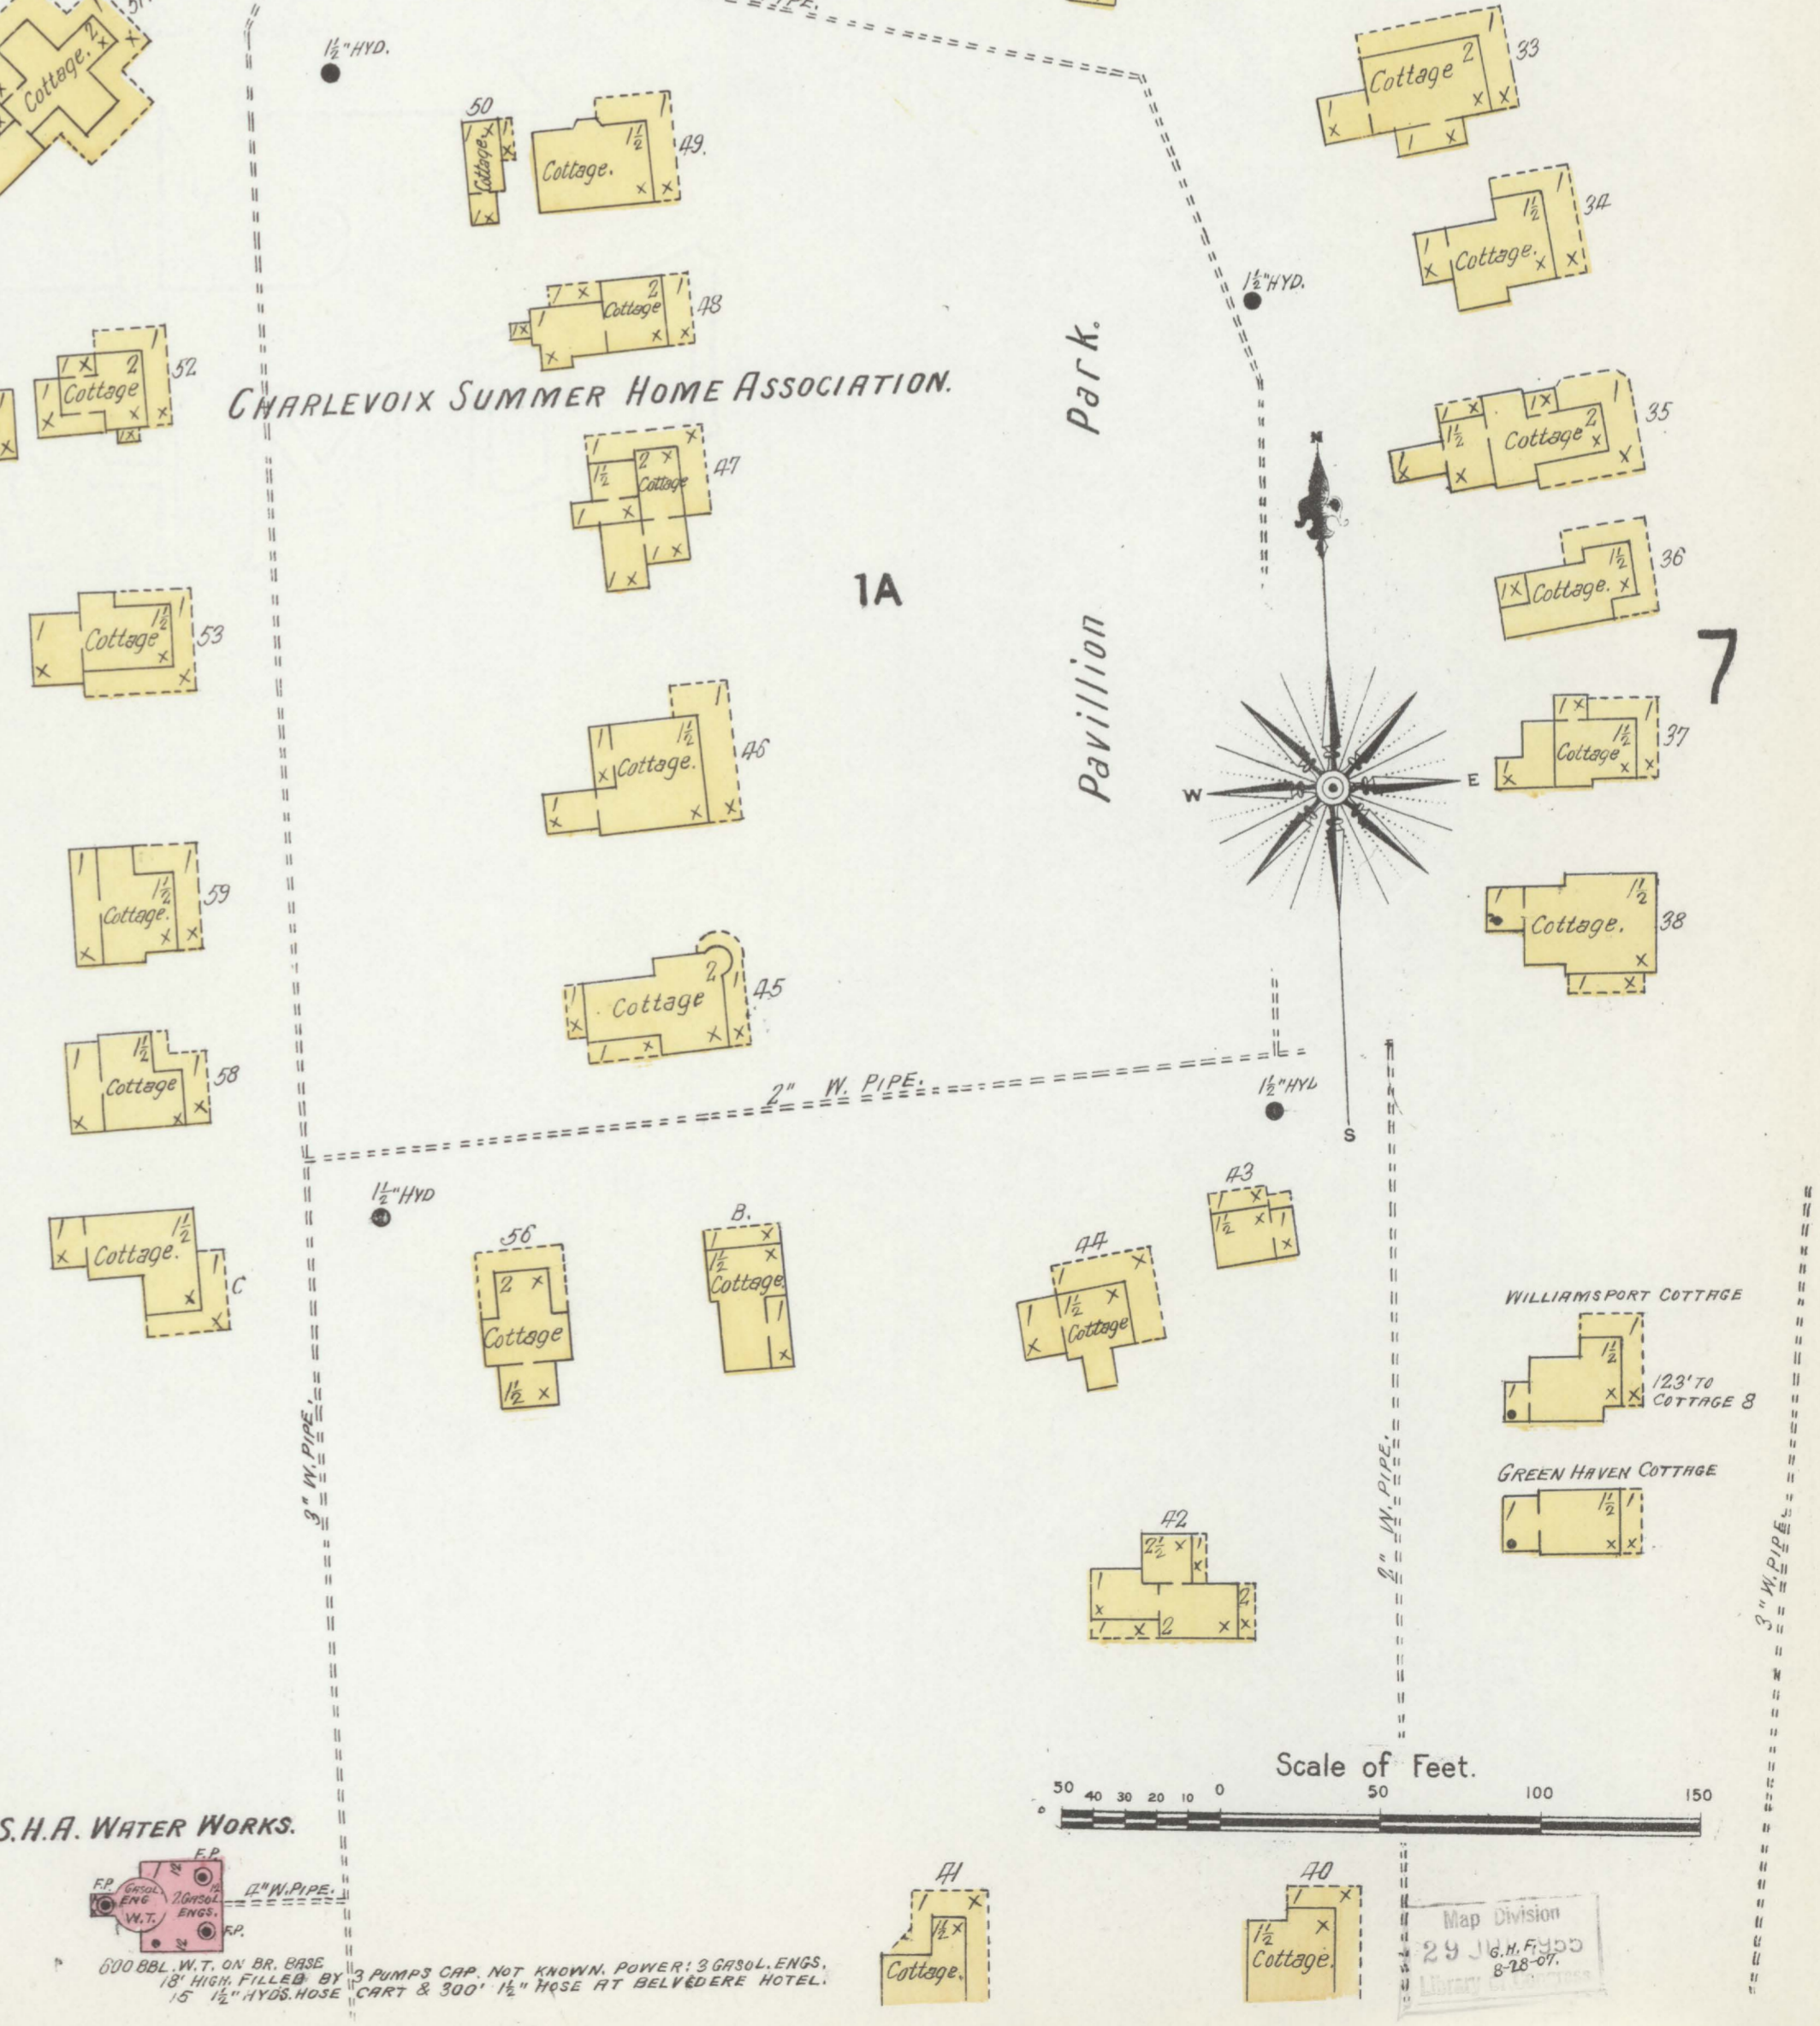

C.S.H.A. WATER WORKS.

600 GALL. W.T. ON BR. BASE
15" WICH. FILLED BY
1 1/2" HYD. HOSE
3 PUMPS CAP. NOT KNOWN. POWER: 3 GASOL. ENGS.
CHART & 300' 1 1/2" HOSE AT BELLEVUE HOTEL.



Map Division
24 J. M. R. 100
8-18-07.

VACANT BEYOND

VACANT BEYOND.

5A

5A

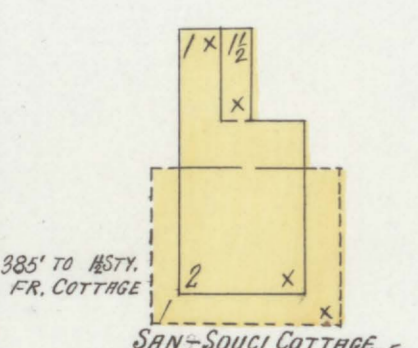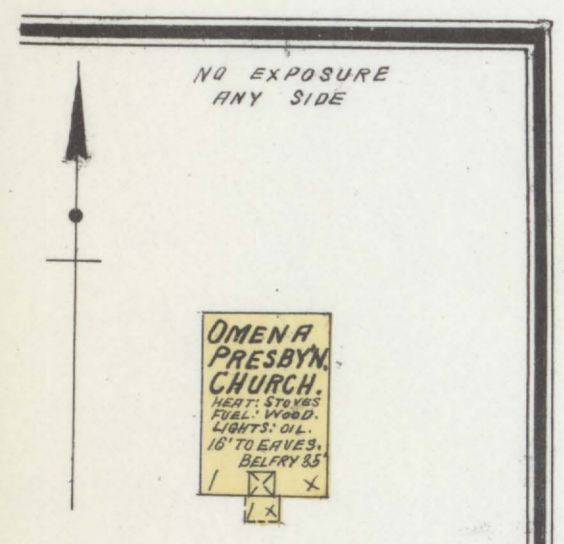

1/2 Mile E. of Omena P.O.

OMENA AV.
GRAND TRAVERSE BAY BEYOND.